

| | |
|----------------------------------|---|
| Name of wastewater system | Cronulla Wastewater Network |
| Map of Network | https://www.sydneywater.com.au/SW/water-the-environment/how-we-manage-sydney-s-water/wastewater-network/index.htm |


| System Summary | Projected | | | |
|---------------------------------|-----------|------|------|------|
| | 2026 | 2031 | 2041 | 2051 |
| Average dry weather flow (ML/d) | 50.3 | 52.1 | 53.9 | 55.3 |

| Infrastructure requirement and Capacity Constraints | | | |
|---|------------------------------------|------------|--------------------------------|
| Planning Horizon | Infrastructure and Location | Purpose | Approximate Capital Cost (\$m) |
| 2026 | Wastewater Network Generator | Growth | \$2.6M |
| 2026 | Wastewater Network Storage | Growth | \$87.6M |
| 2030 | Wastewater Network System | Growth | \$19.9M |
| 2030 | Wastewater Network System | Regulatory | \$1.9M |
| 2030 | Wastewater Network Wastewater main | Growth | \$30.4M |
| 2030 | Water Network System | Growth | \$10.5M |

| Information sources, where publicly available |
|---|
| N/A (not publicly available) |

| Further investigations |
|---|
| Refer to Growth Servicing Plan 2022-2027: |
| https://www.sydneywater.com.au/plumbing-building-developing/developing/growth-servicing-plan.html |

*Approximated storage is used as an indicator of system upgrade requirements, but these would be subjected to an options assessment to identify a preferred solution.

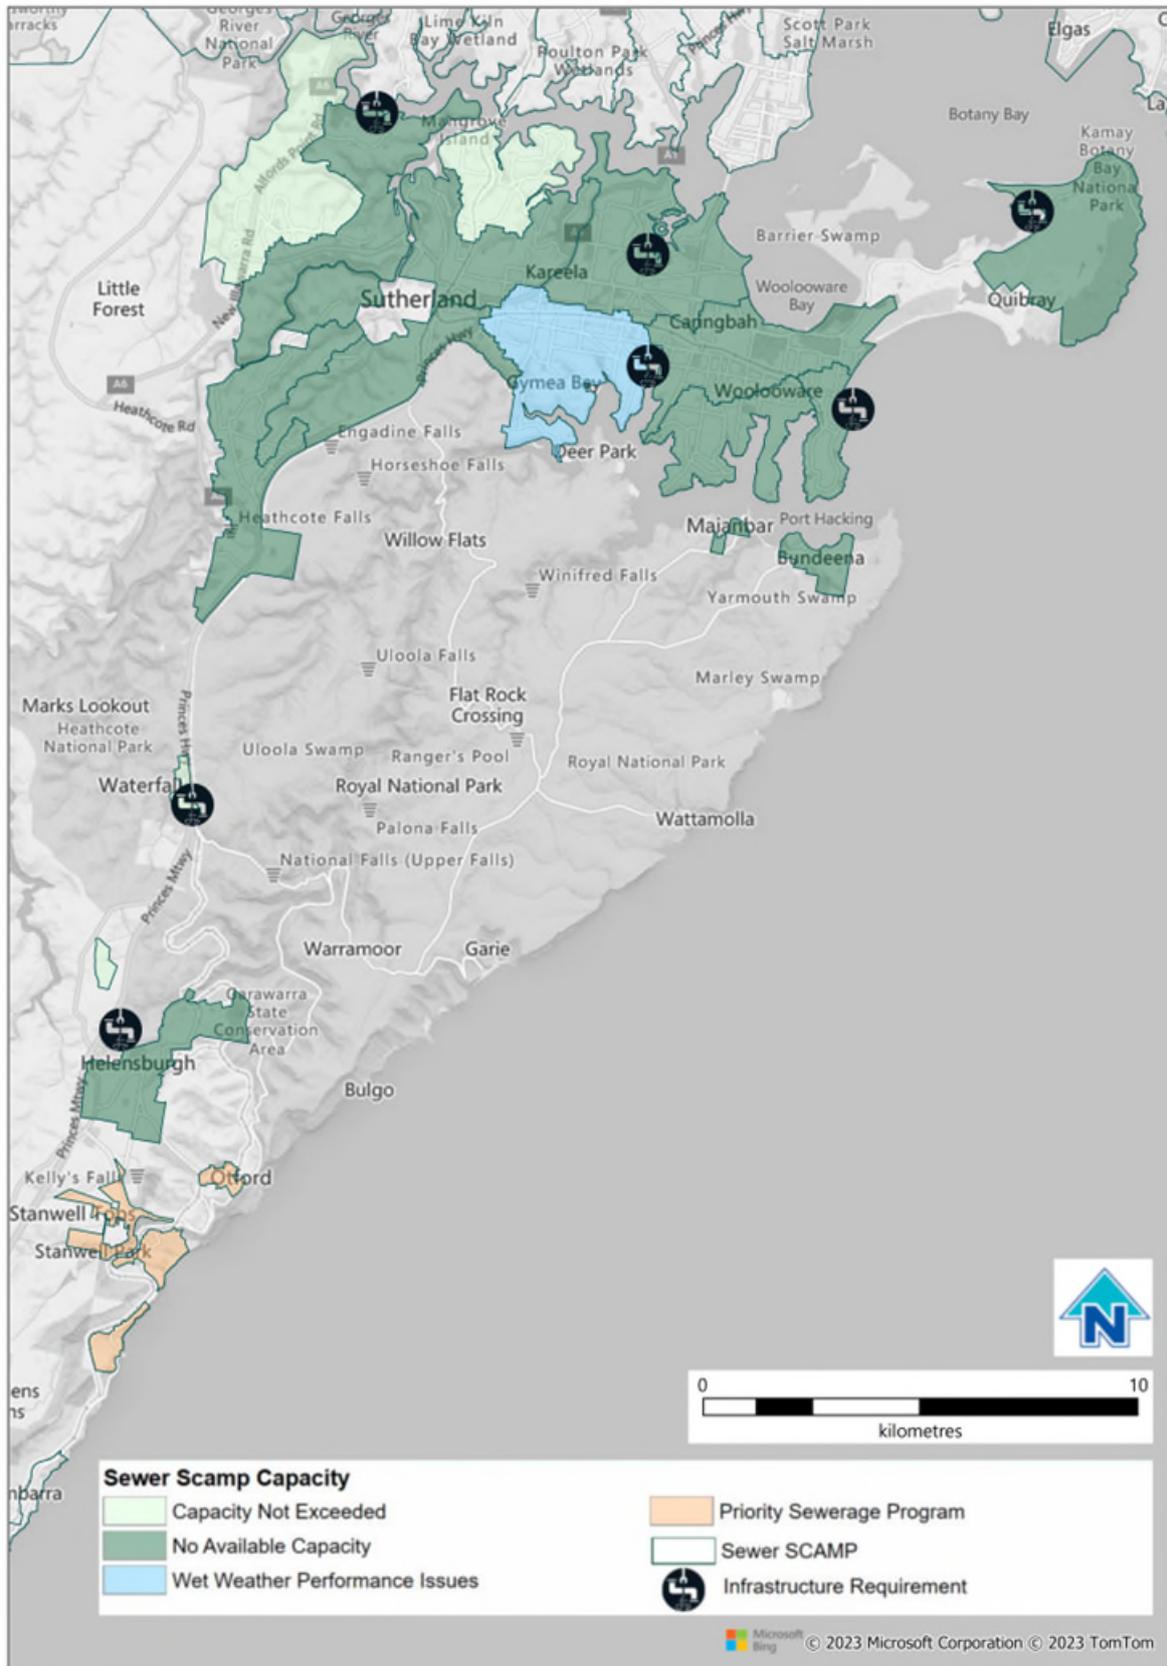

© June 2023 Sydney Water
 While Sydney Water has made every effort to provide information that is up to date, this information can be affected by many factors and is provided as a guide only. Sydney Water makes no representation, warranty, undertaking or guarantee (express or implied) that the information provided in this document is accurate, reliable or complete.