



NOTES:

1. ABRABE AND WIRE BRUSH CLEAN ALL UPPER AND LOWER JOINT SURFACES TO REMOVE LAITANCE. APPLY SIKADUR-32 EPOXY RESIN PRIMER OR APPROVED EQUIVALENT TO BOTH SURFACES PRIOR TO APPLICATION OF EPOXY MORTAR.
2. INTERNAL COATING NOT REQUIRED FOR VALVE CHAMBER AND GAS CHECK MAINTENANCE HOLE.
3. BASE INSTALLATION CAN BE CIRCULAR OR SQUARE. DESIGNER TO CHECK BUOYANCY FORCES FOR SITE SPECIFIC PUMP STATION DEPTH.

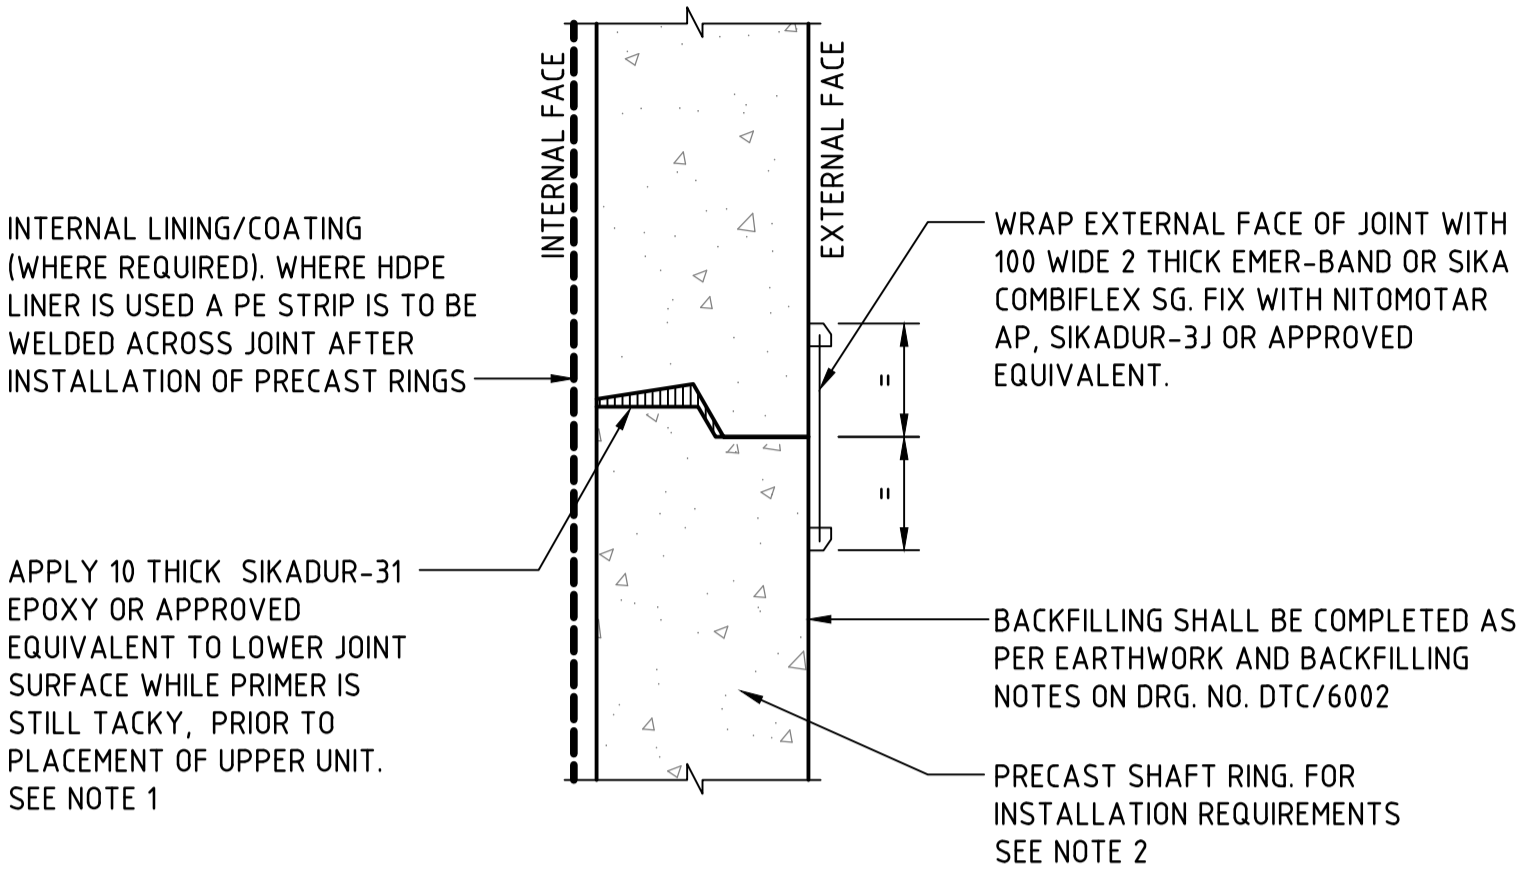


PRECAST SHAFT RING CONNECTION

DETAIL	A	A	A
SCALE 1:5	6013	6016	6017

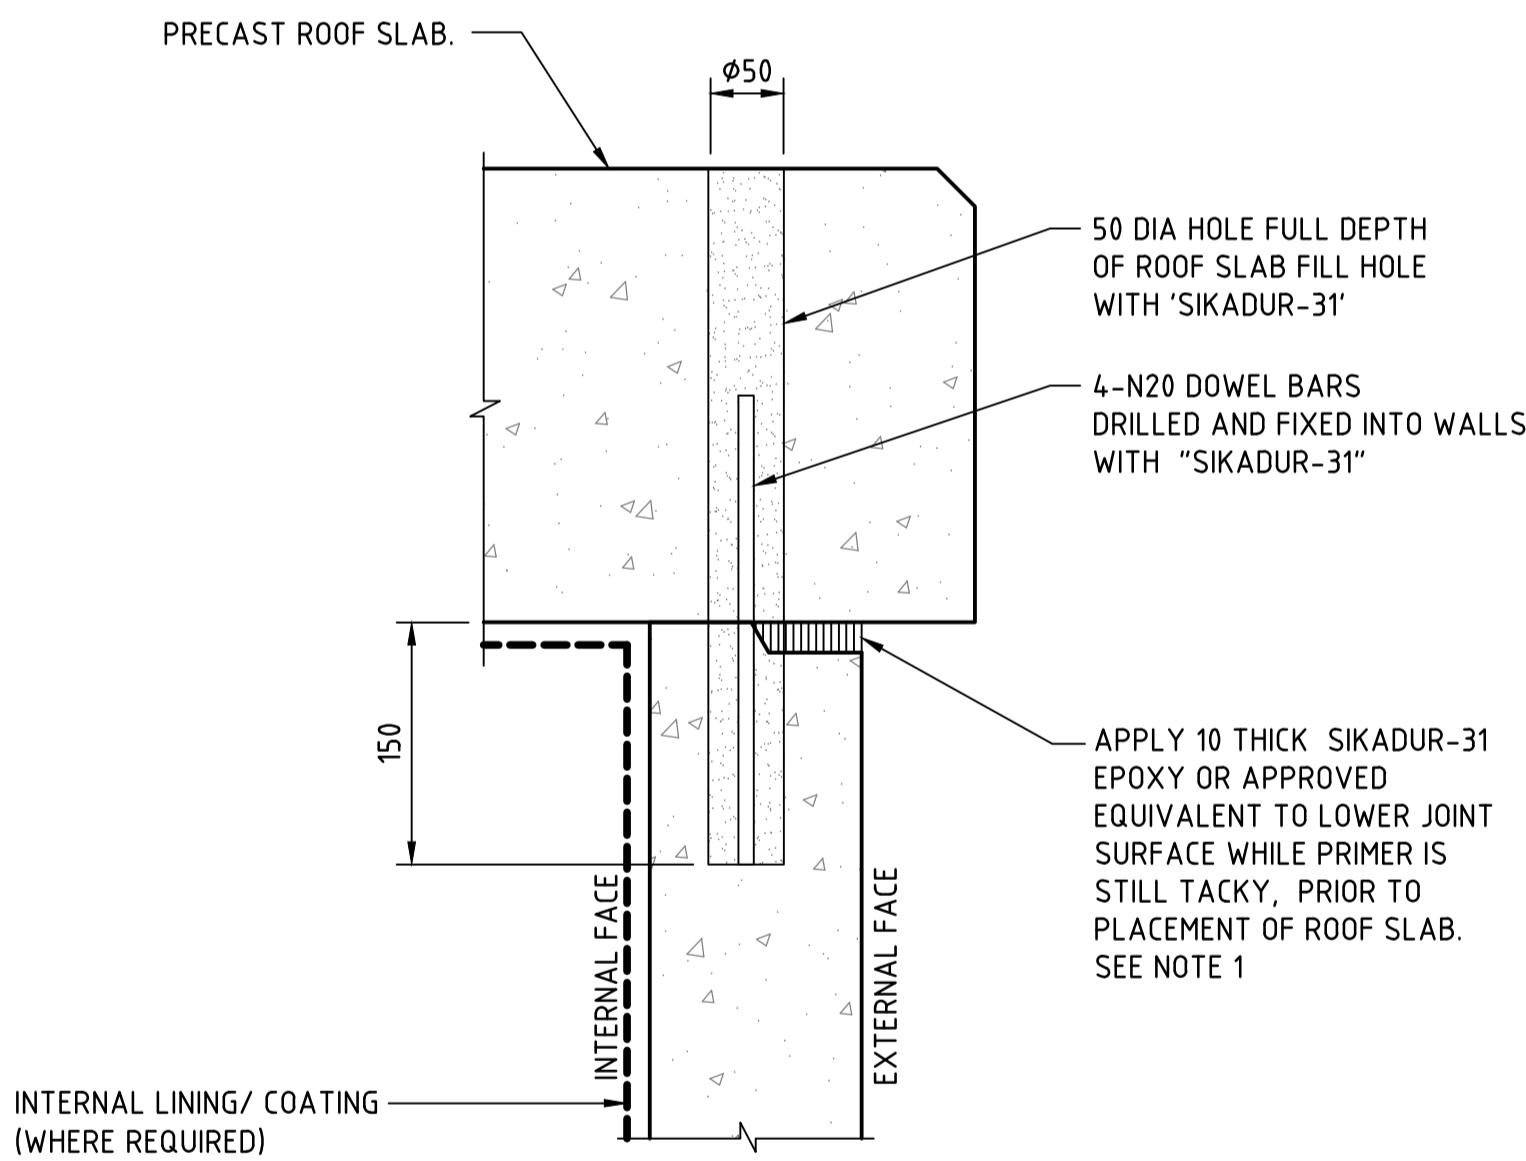


PRECAST ROOF TO SHAFT CONNECTION

DETAIL	B	B	B
SCALE 1:5	6013	6016	6017

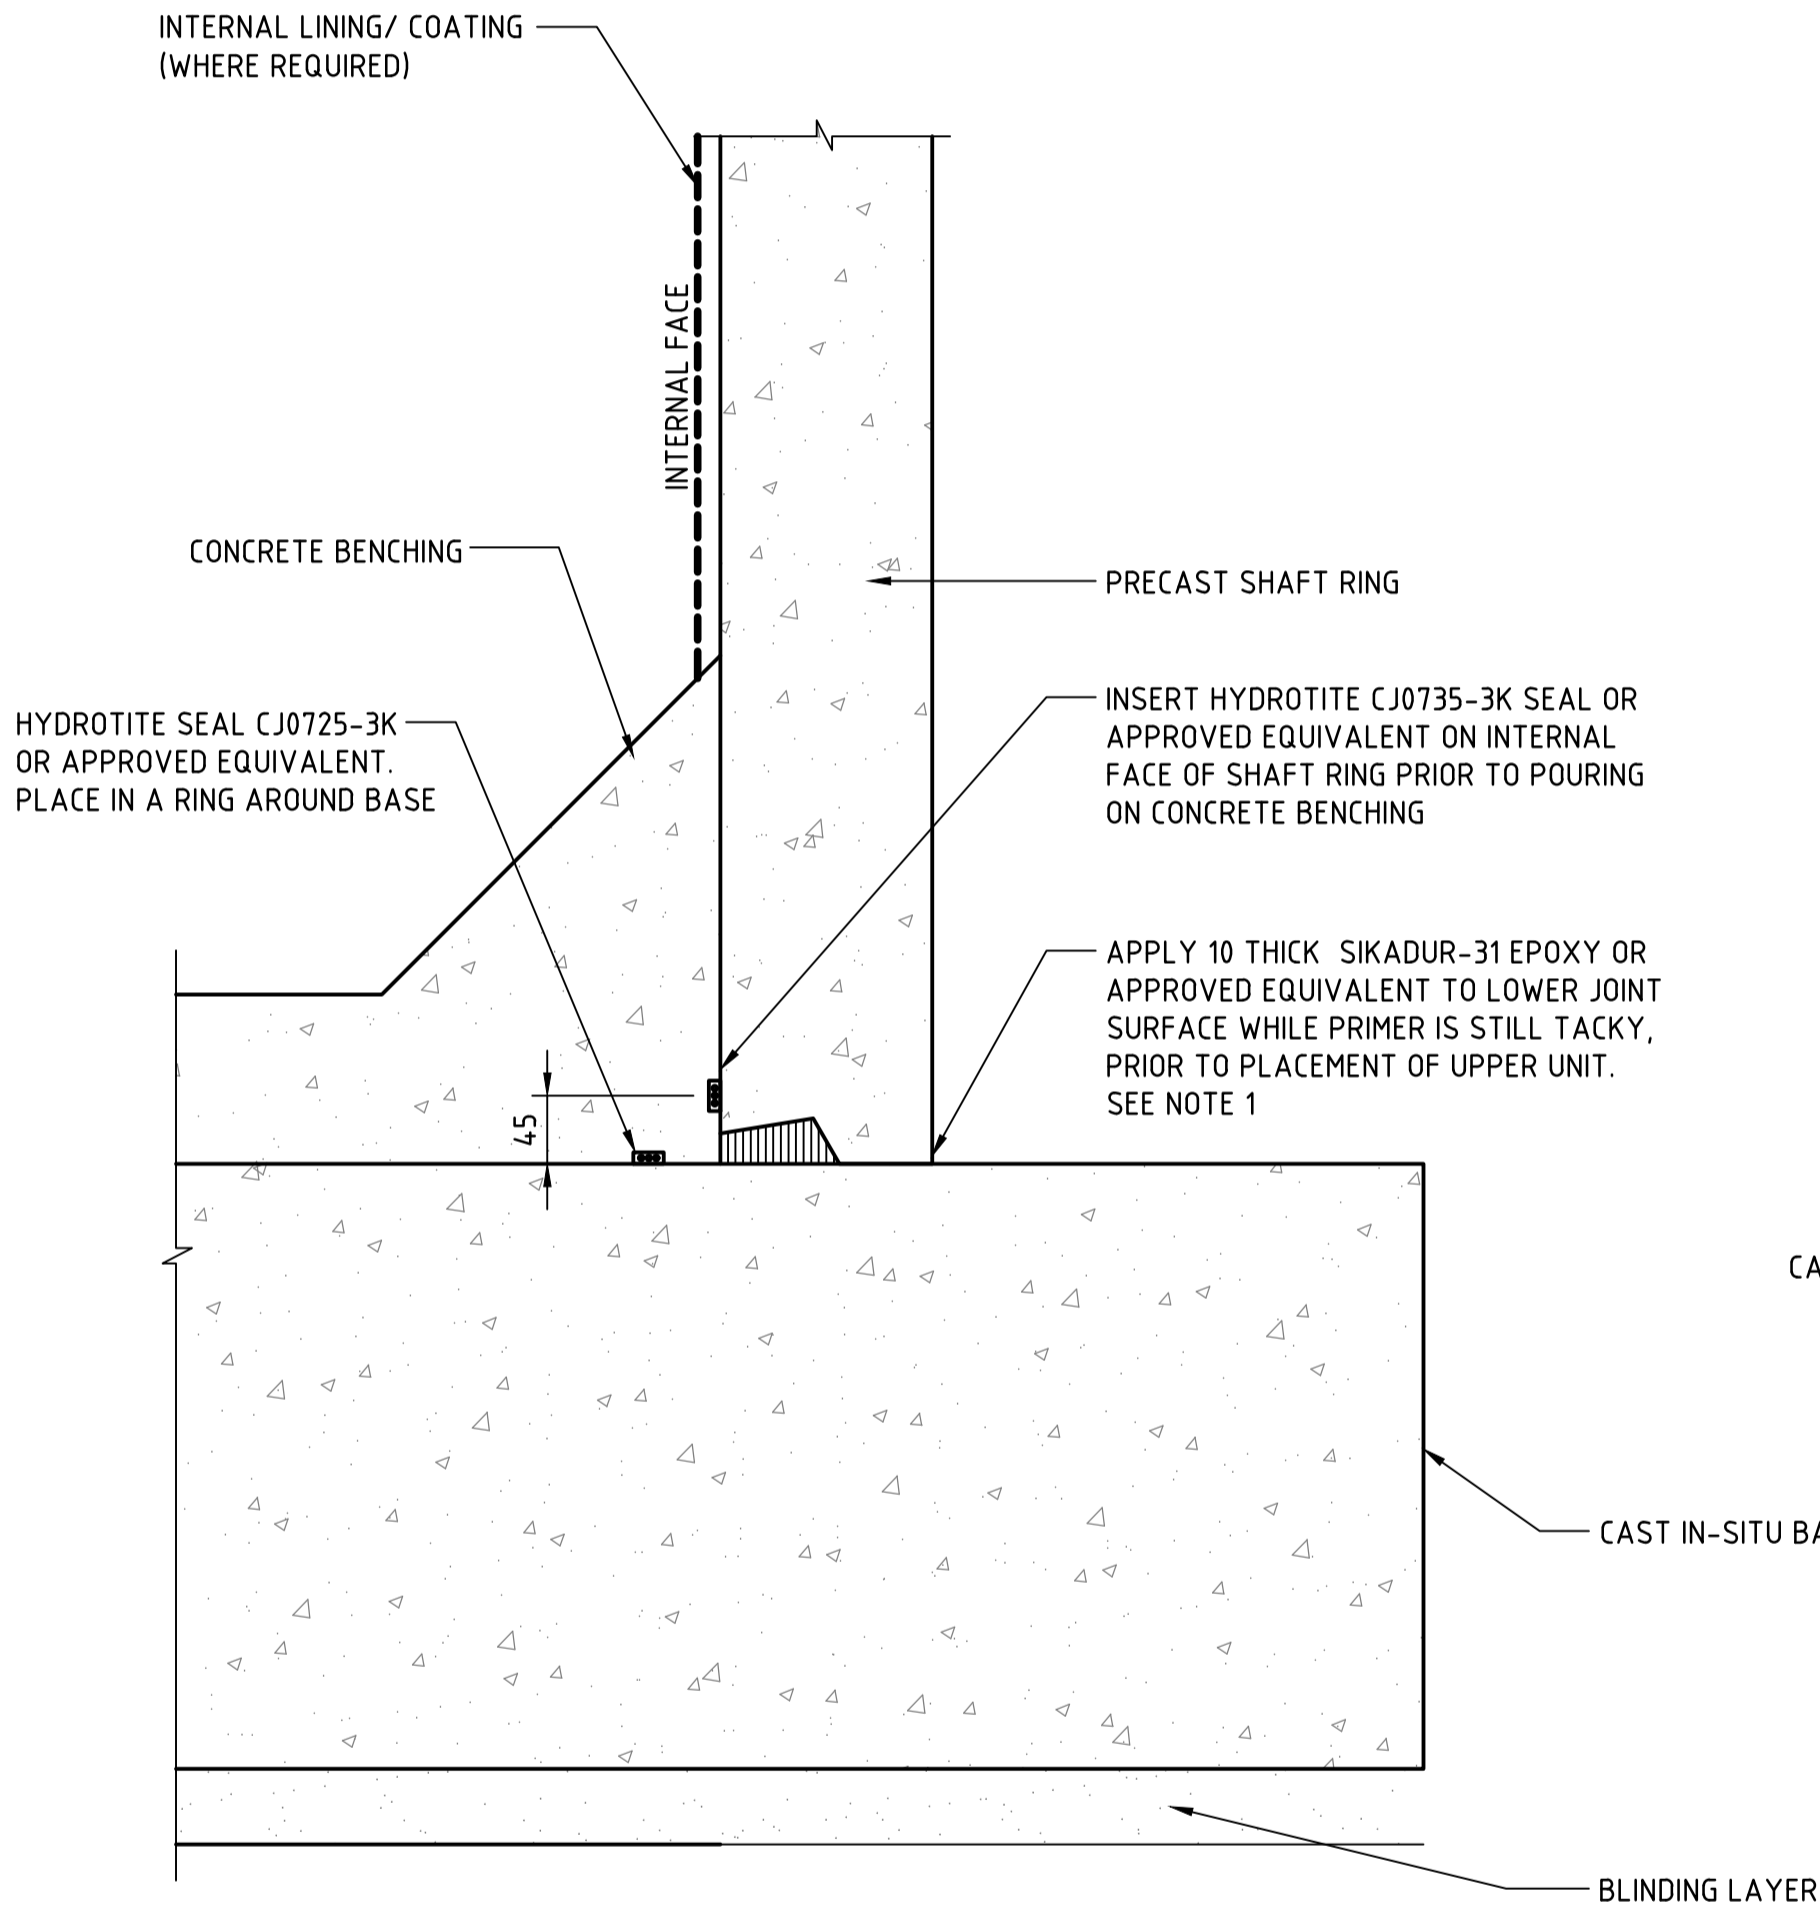

PRECAST BASE TO SHAFT CONNECTION

DETAIL	C	C	C
SCALE 1:5	6013	6016	6017

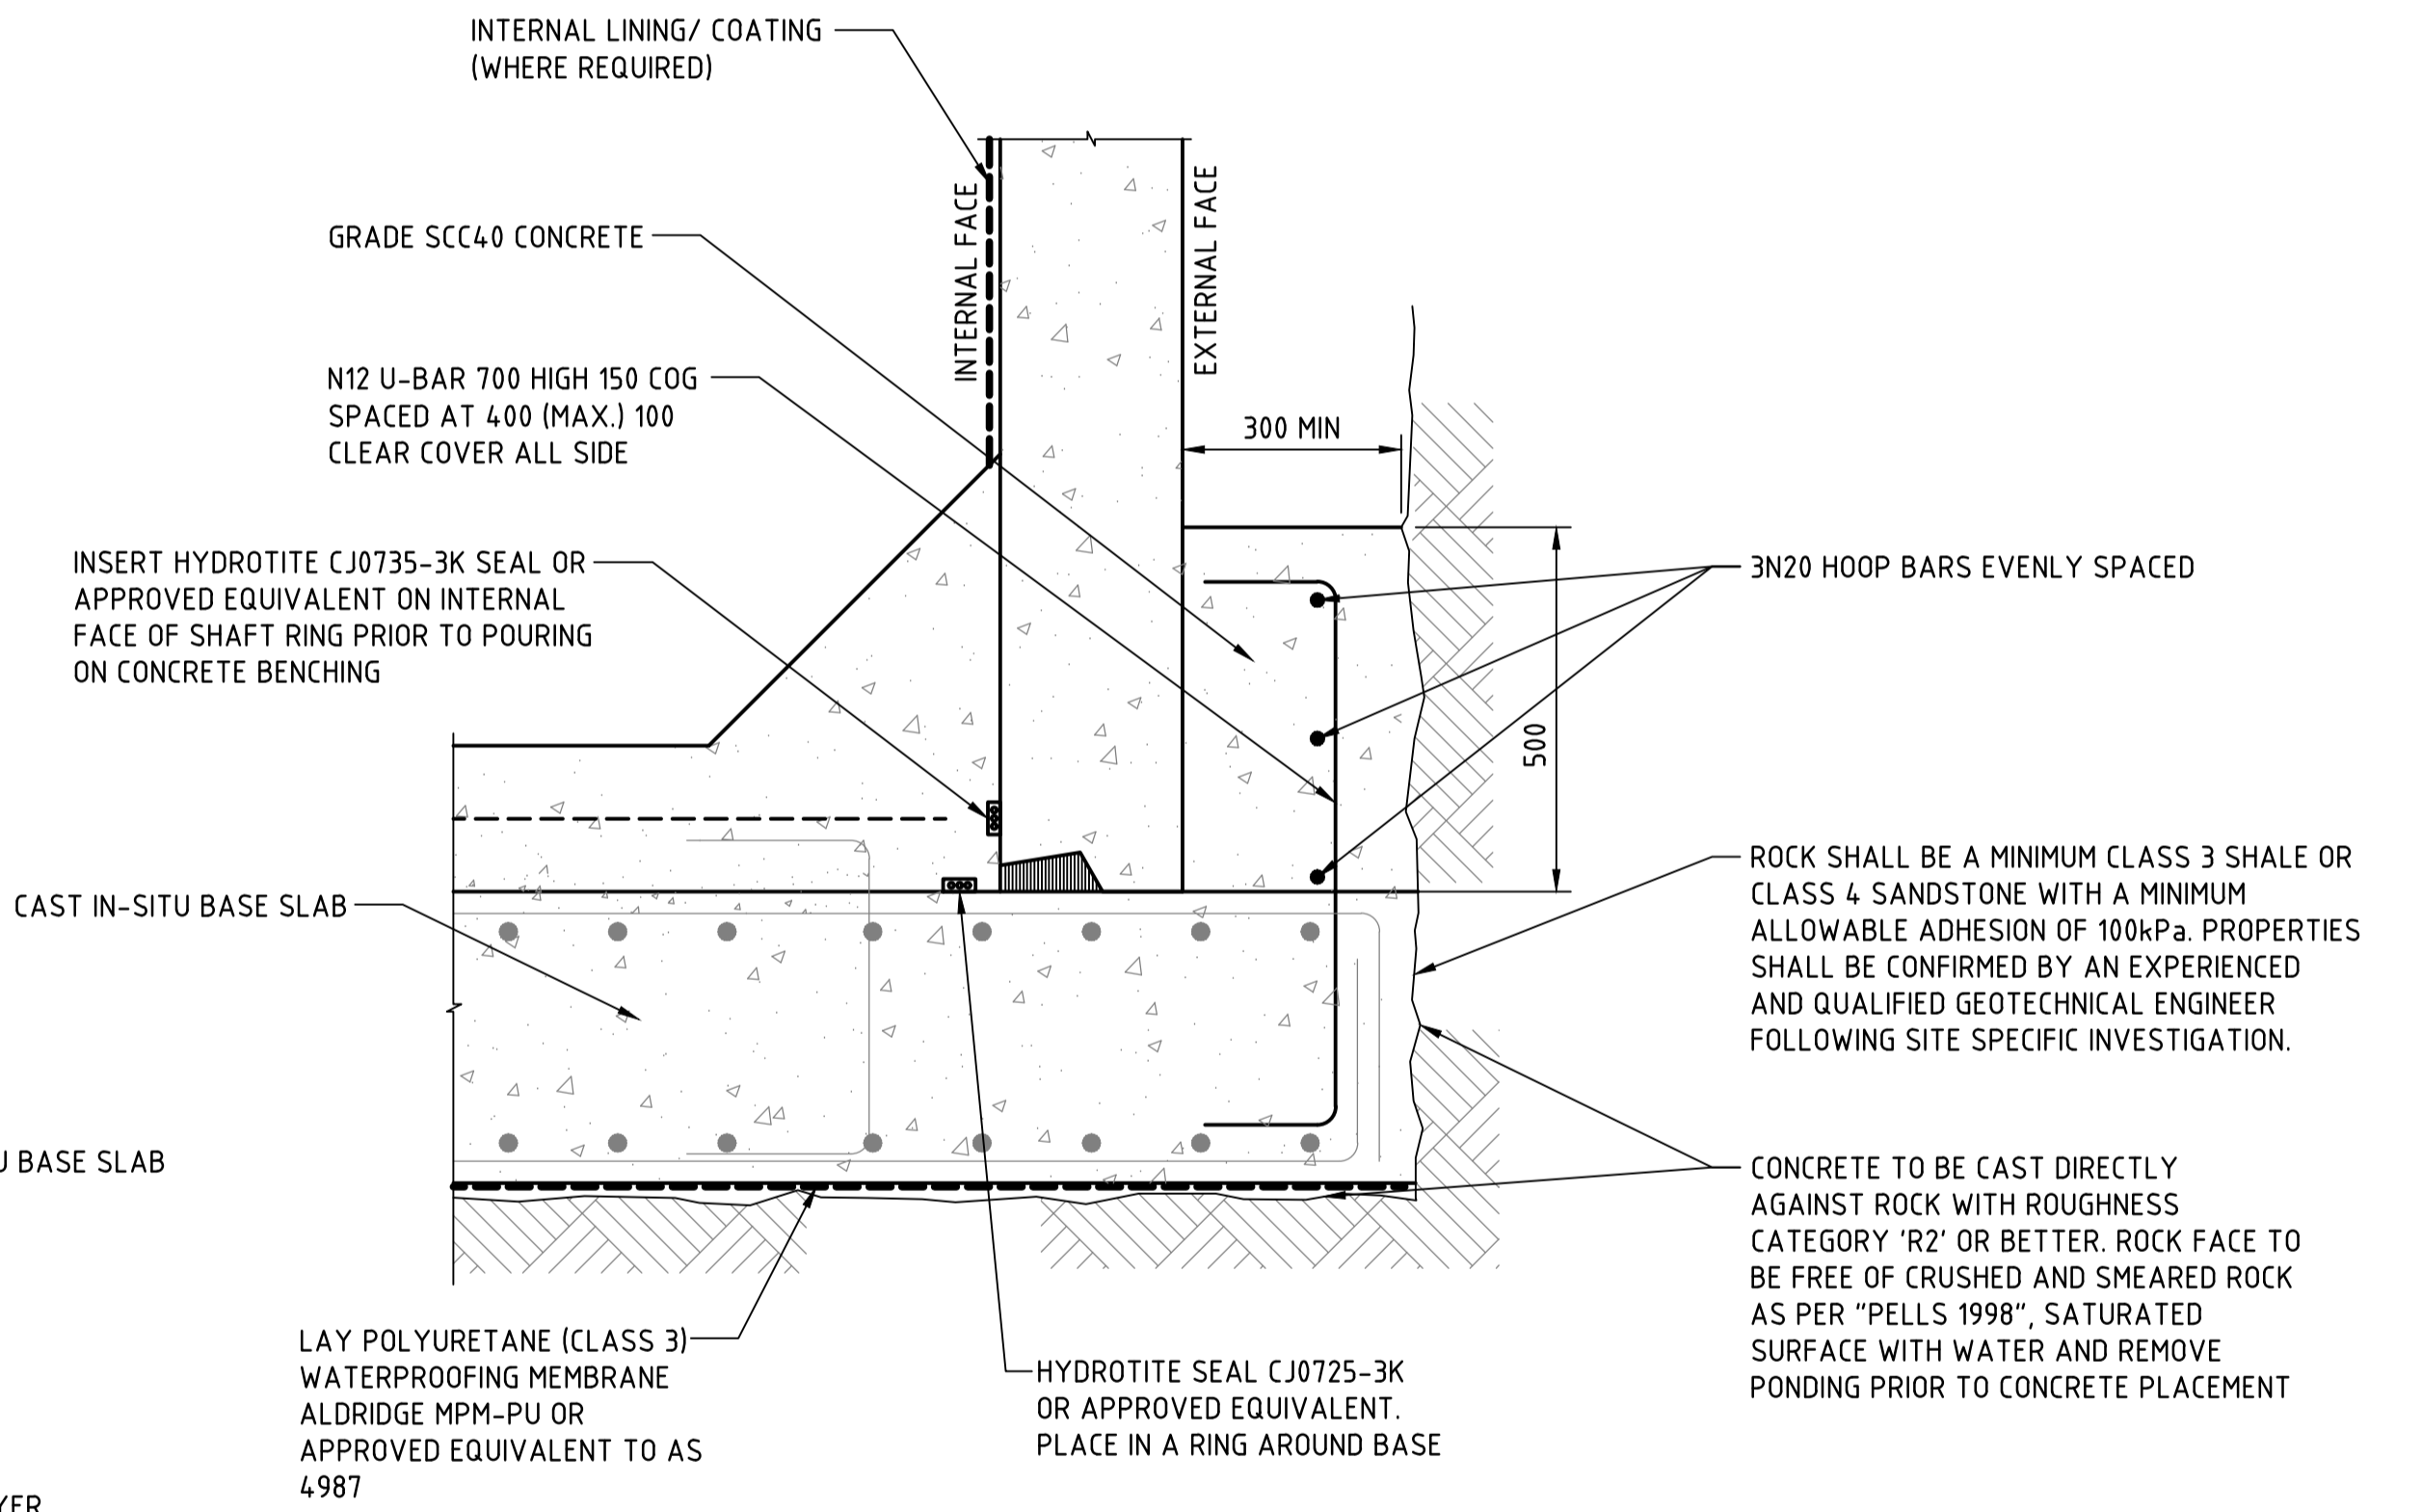

WHERE SUITABLE ROCK IS DETERMINED. REFER TO NOTE 11 ON DRG. NO. DTC/6001
**BASE SLAB TO SHAFT CONNECTION ARRANGMENT FOR
FIXED INTO ROCK APPLICATION**
SCALE 1:10

B	GENERAL UPDATE (PREVIOUSLY DRAWING DTC/6014)	NS	25/06/21
A	ORIGINAL ISSUE	KW	22/06/15
LETTER	DETAILS OF ISSUE / AMENDMENT	APP'D	DATE

ISSUE	DATE
B	25/06/21