



A 1

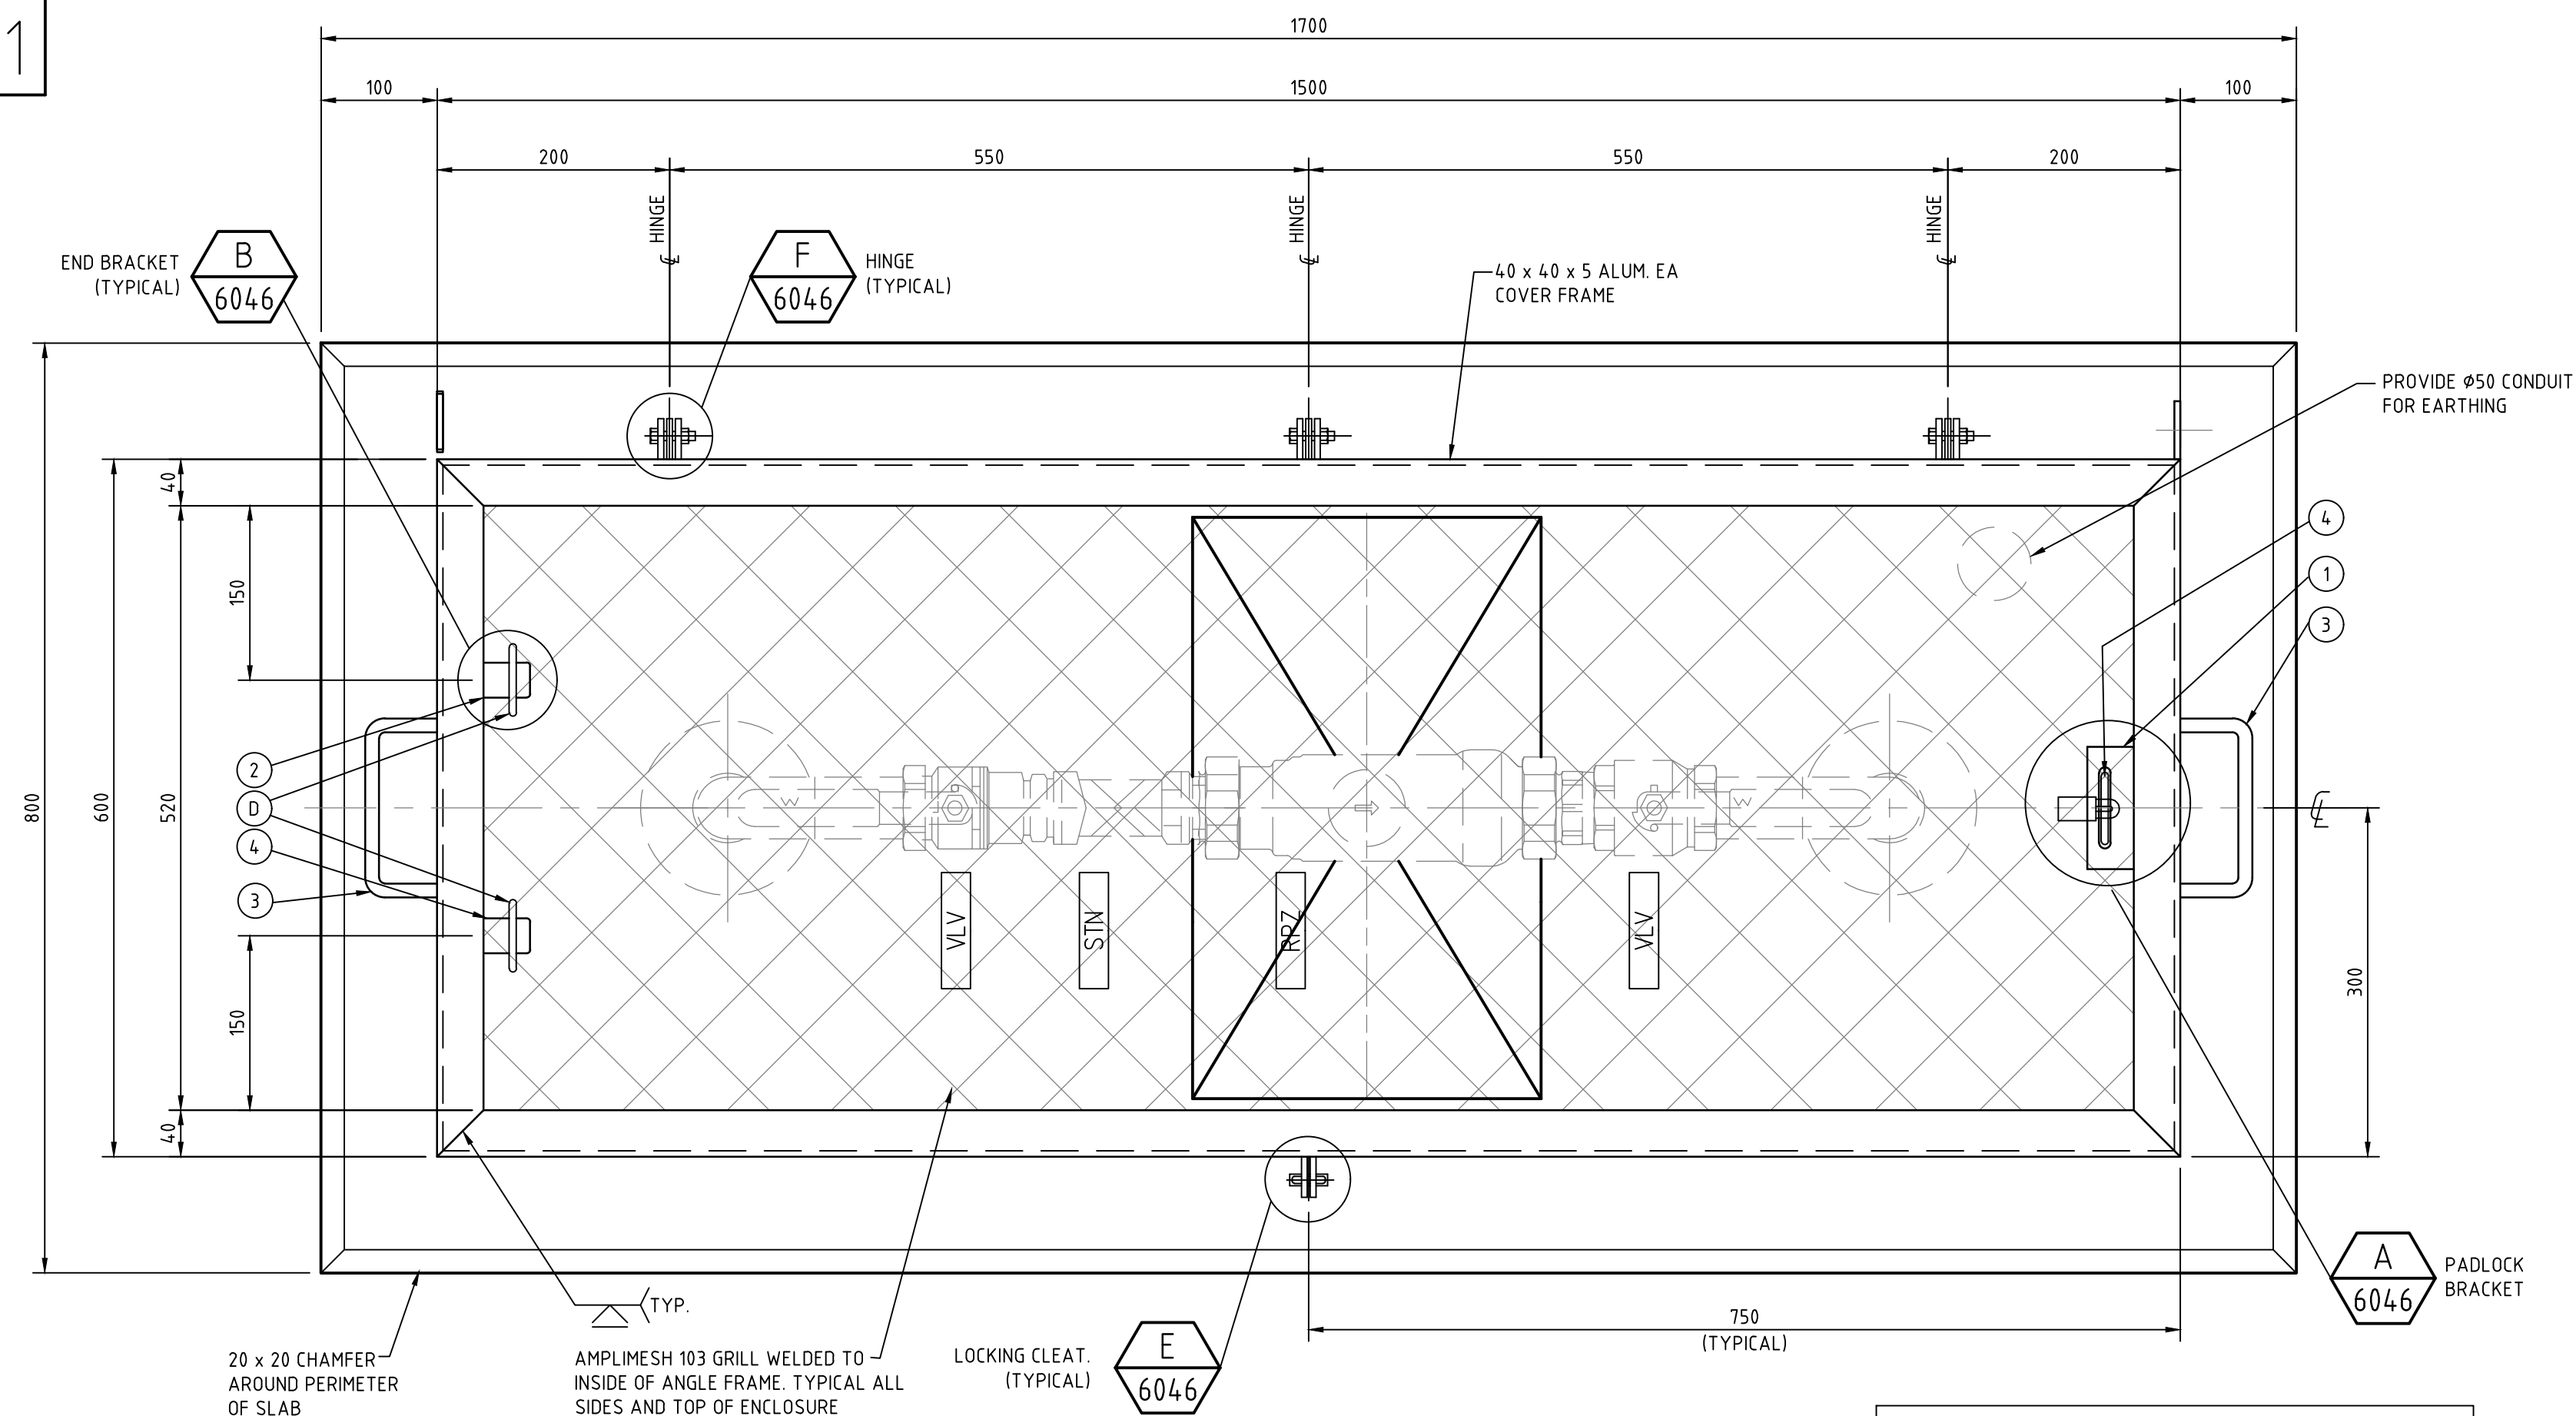


(REFER NOTE 1 & 4)  
PLAN OF ENCLOSURE - SITE RPZ  
SCALE 1:5

**RPZD BASE SLAB 1700x800:**  
100 MINIMUM THICK SLAB PLACED ON 0.25mm THICK PVC MEMBRANE AND 50mm THICK BLINDING CONCRETE. REINFORCE WITH SL81 FABRIC PLACED CENTRALLY. PROVIDE SLOPED SURFACE (500x300) TO DRAIN LINE.

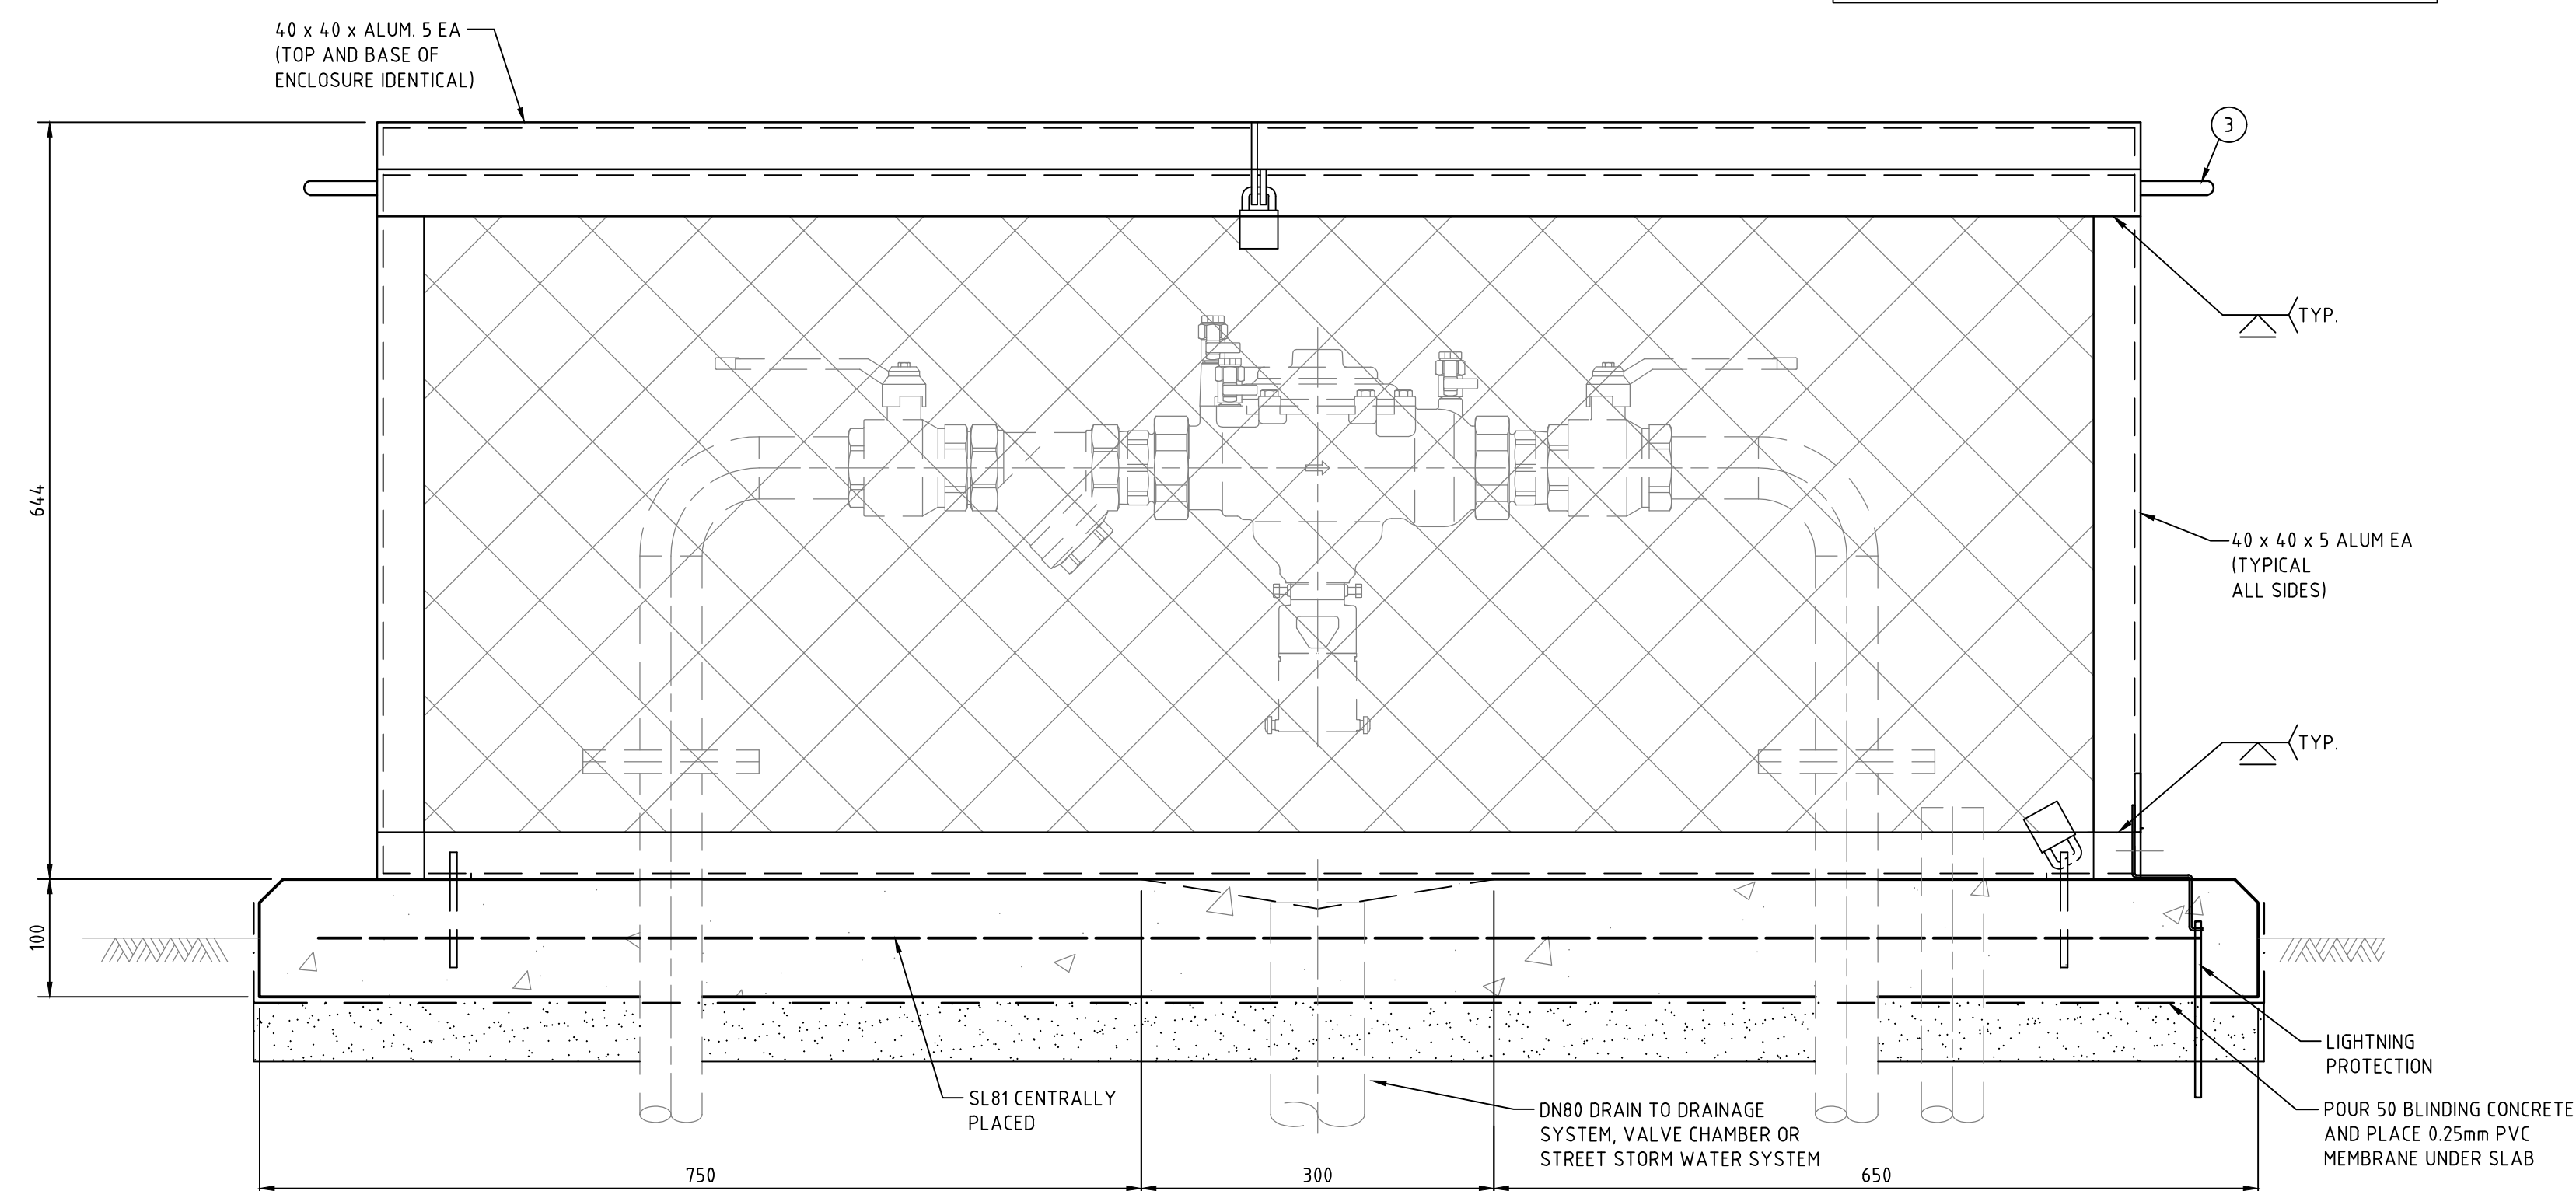


ELEVATION OF ENCLOSURE  
SCALE 1:5



## PIPEWORK ARRANGEMENT

- NOTES:**
1. FOR RPZD SITE INSTALLATION REQUIREMENTS REFER TABLE ON DRAWING DTC/6046.
  2. FOR DUAL RPZ REFER TO DRAWING DTC/6045.
  3. FOR BILL OF MATERIAL AND FURTHER DETAILS REFER TO DRAWING DTC/6046.
  4. ARRANGEMENT CAN BE USED FOR SINGLE DN25 RPZD INSTALLATION.



SIDE ELEVATION OF ENCLOSURE  
SCALE 1:5