



A 1

THIS DRAWING MAY ONLY BE USED IN THE COURSE OF AND FOR THE PURPOSE OF CREATING SYDNEY WATER ASSETS.
USE THIS DRAWING WITH CARE. THE USER IS RESPONSIBLE FOR THE CORRECT APPLICATION OF THIS DRAWING
THE USE OF DTC DRAWINGS IS SUBJECT TO TERMS AND CONDITIONS AS PUBLISHED BY SYDNEY WATER.

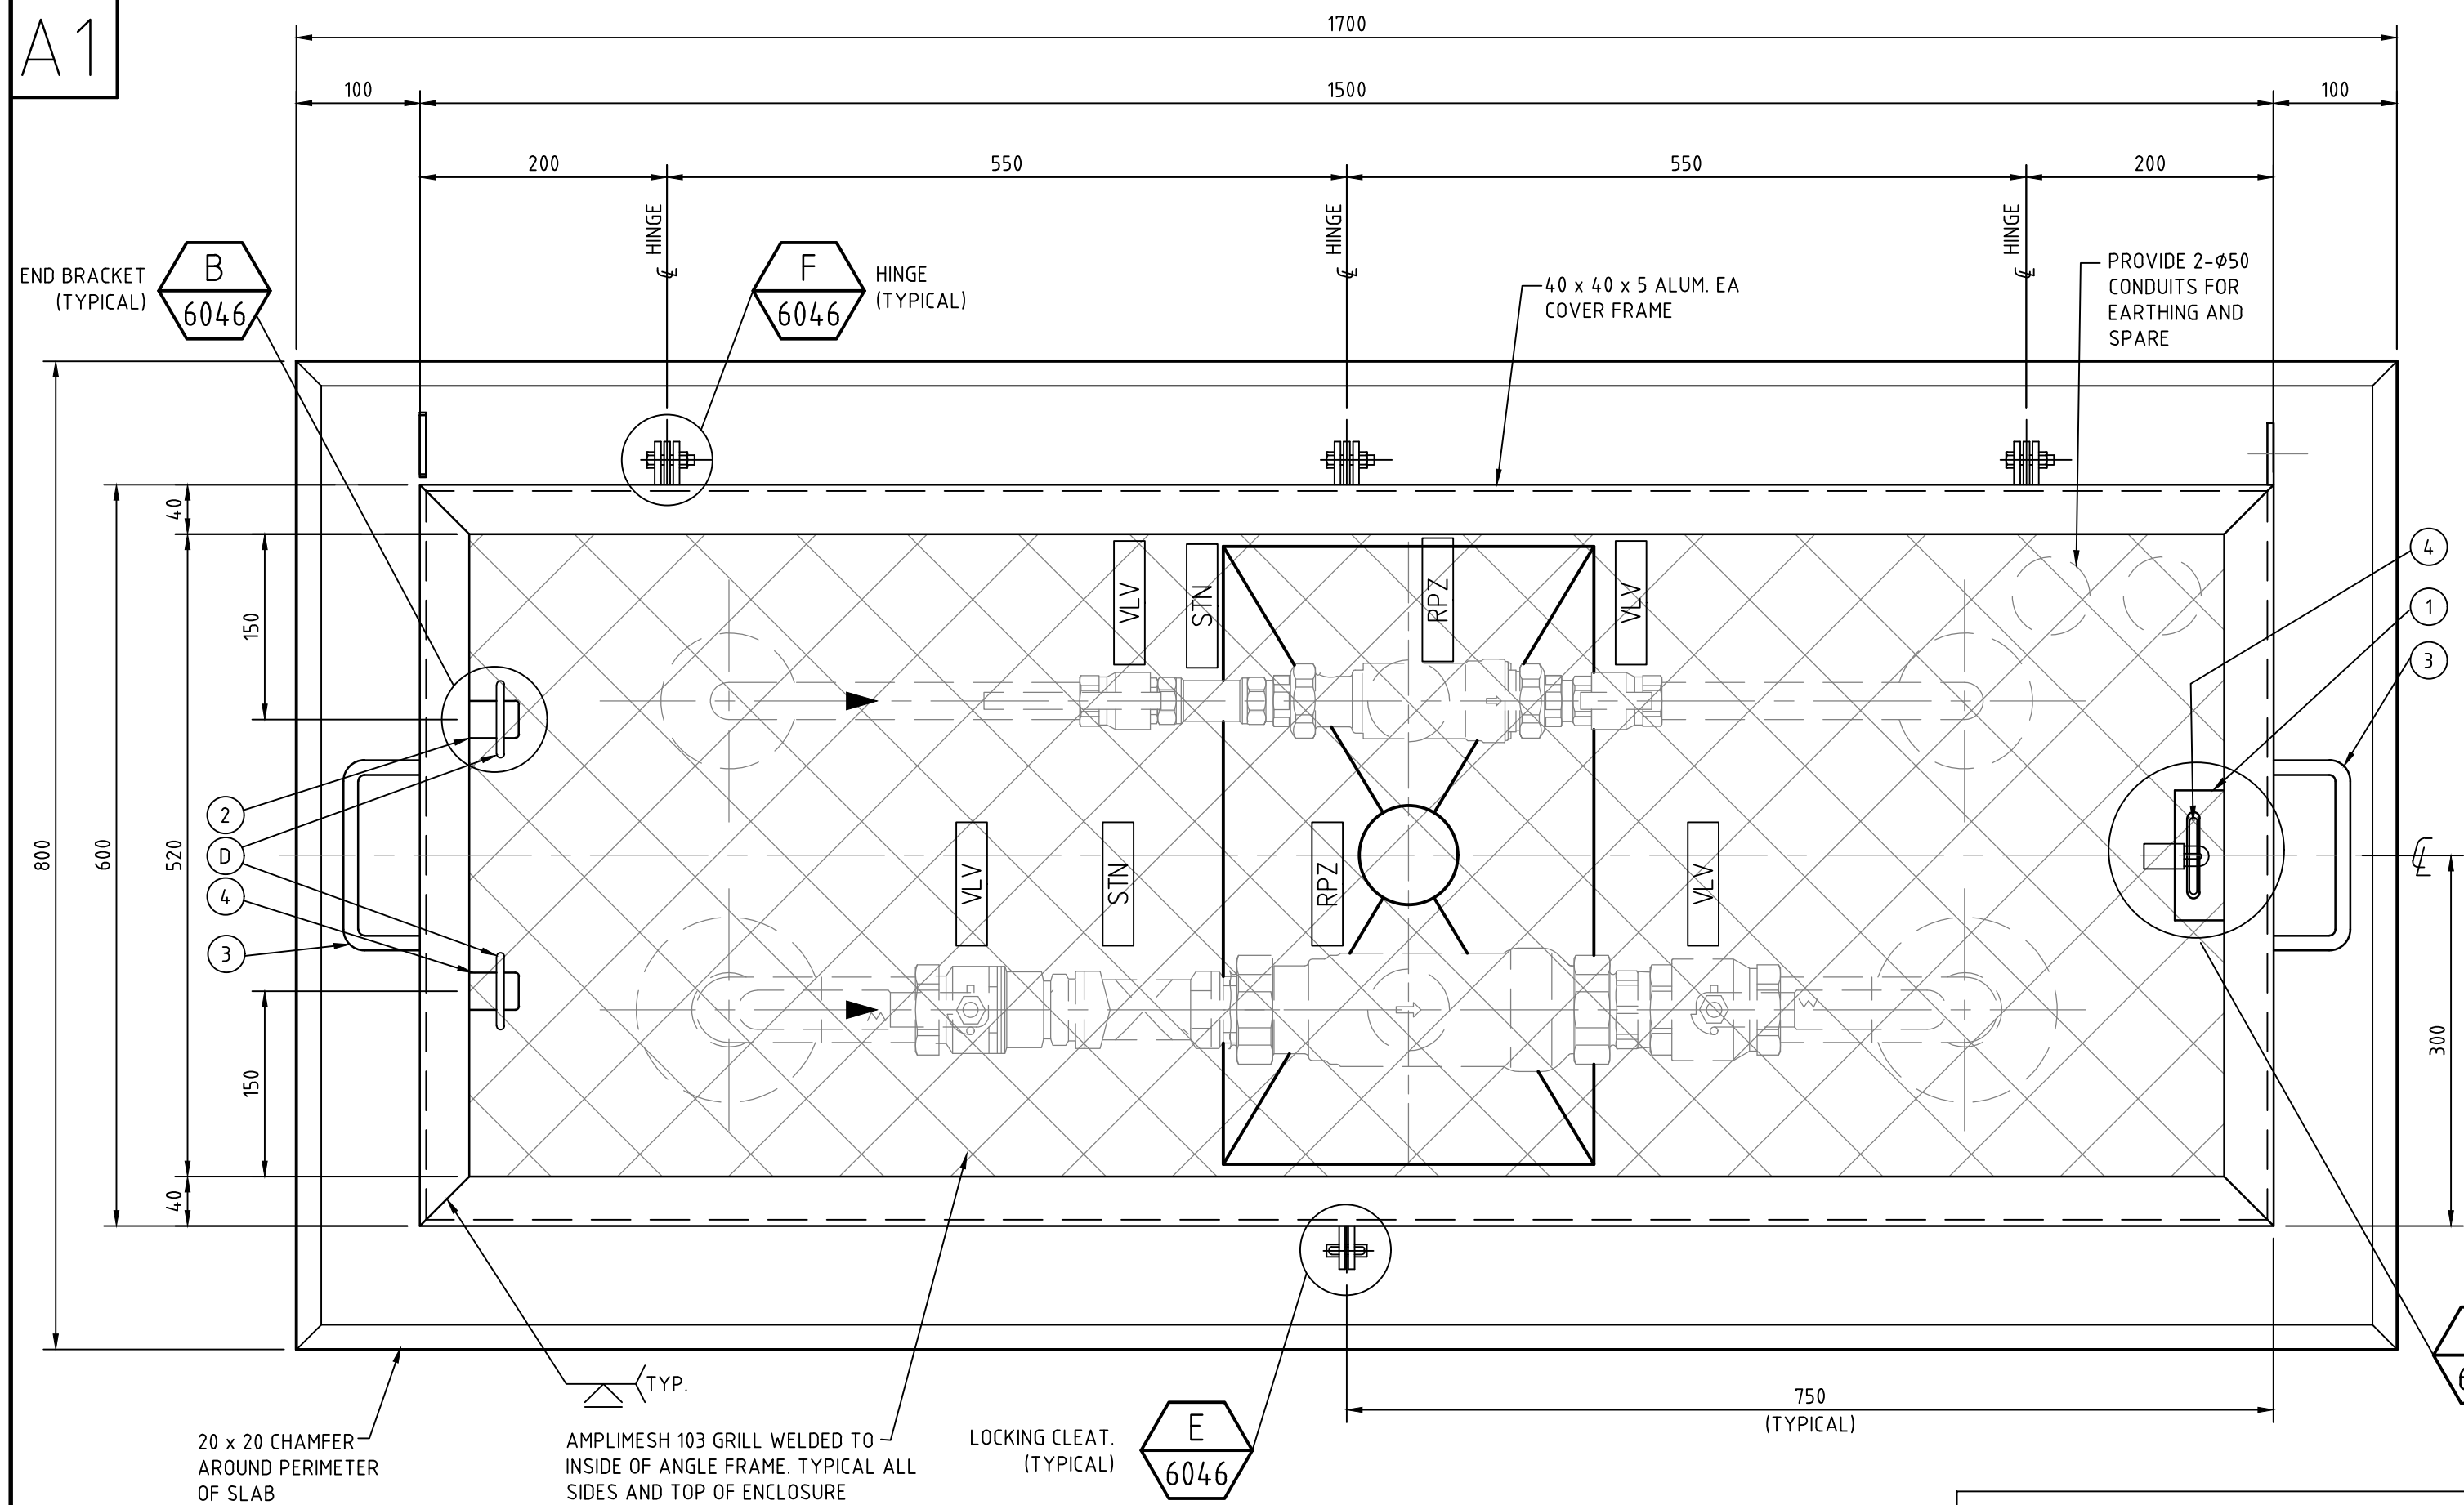

PLAN OF ENCLOSURE - SITE RPZ
SCALE 1:5


RPZD BASE SLAB 1700x800:
100 MINIMUM THICK SLAB PLACED ON 0.25mm THICK PVC MEMBRANE
AND 50mm THICK BLINDING CONCRETE. REINFORCE WITH SL81
FABRIC PLACED CENTRALLY. PROVIDE SLOPED SURFACE (500x300)
TO DRAIN LINE.




PIPEWORK ARRANGEMENT

SCALE 1:10

- NOTES:**
1. FOR RPZD SITE INSTALLATION REQUIREMENTS REFER TABLE ON DRAWING DTC/6046.
 2. FOR SINGLE RPZ REFER TO DRAWING DTC/6045.
 3. FOR BILL OF MATERIAL AND FURTHER DETAILS REFER TO DRAWING DTC/6046.

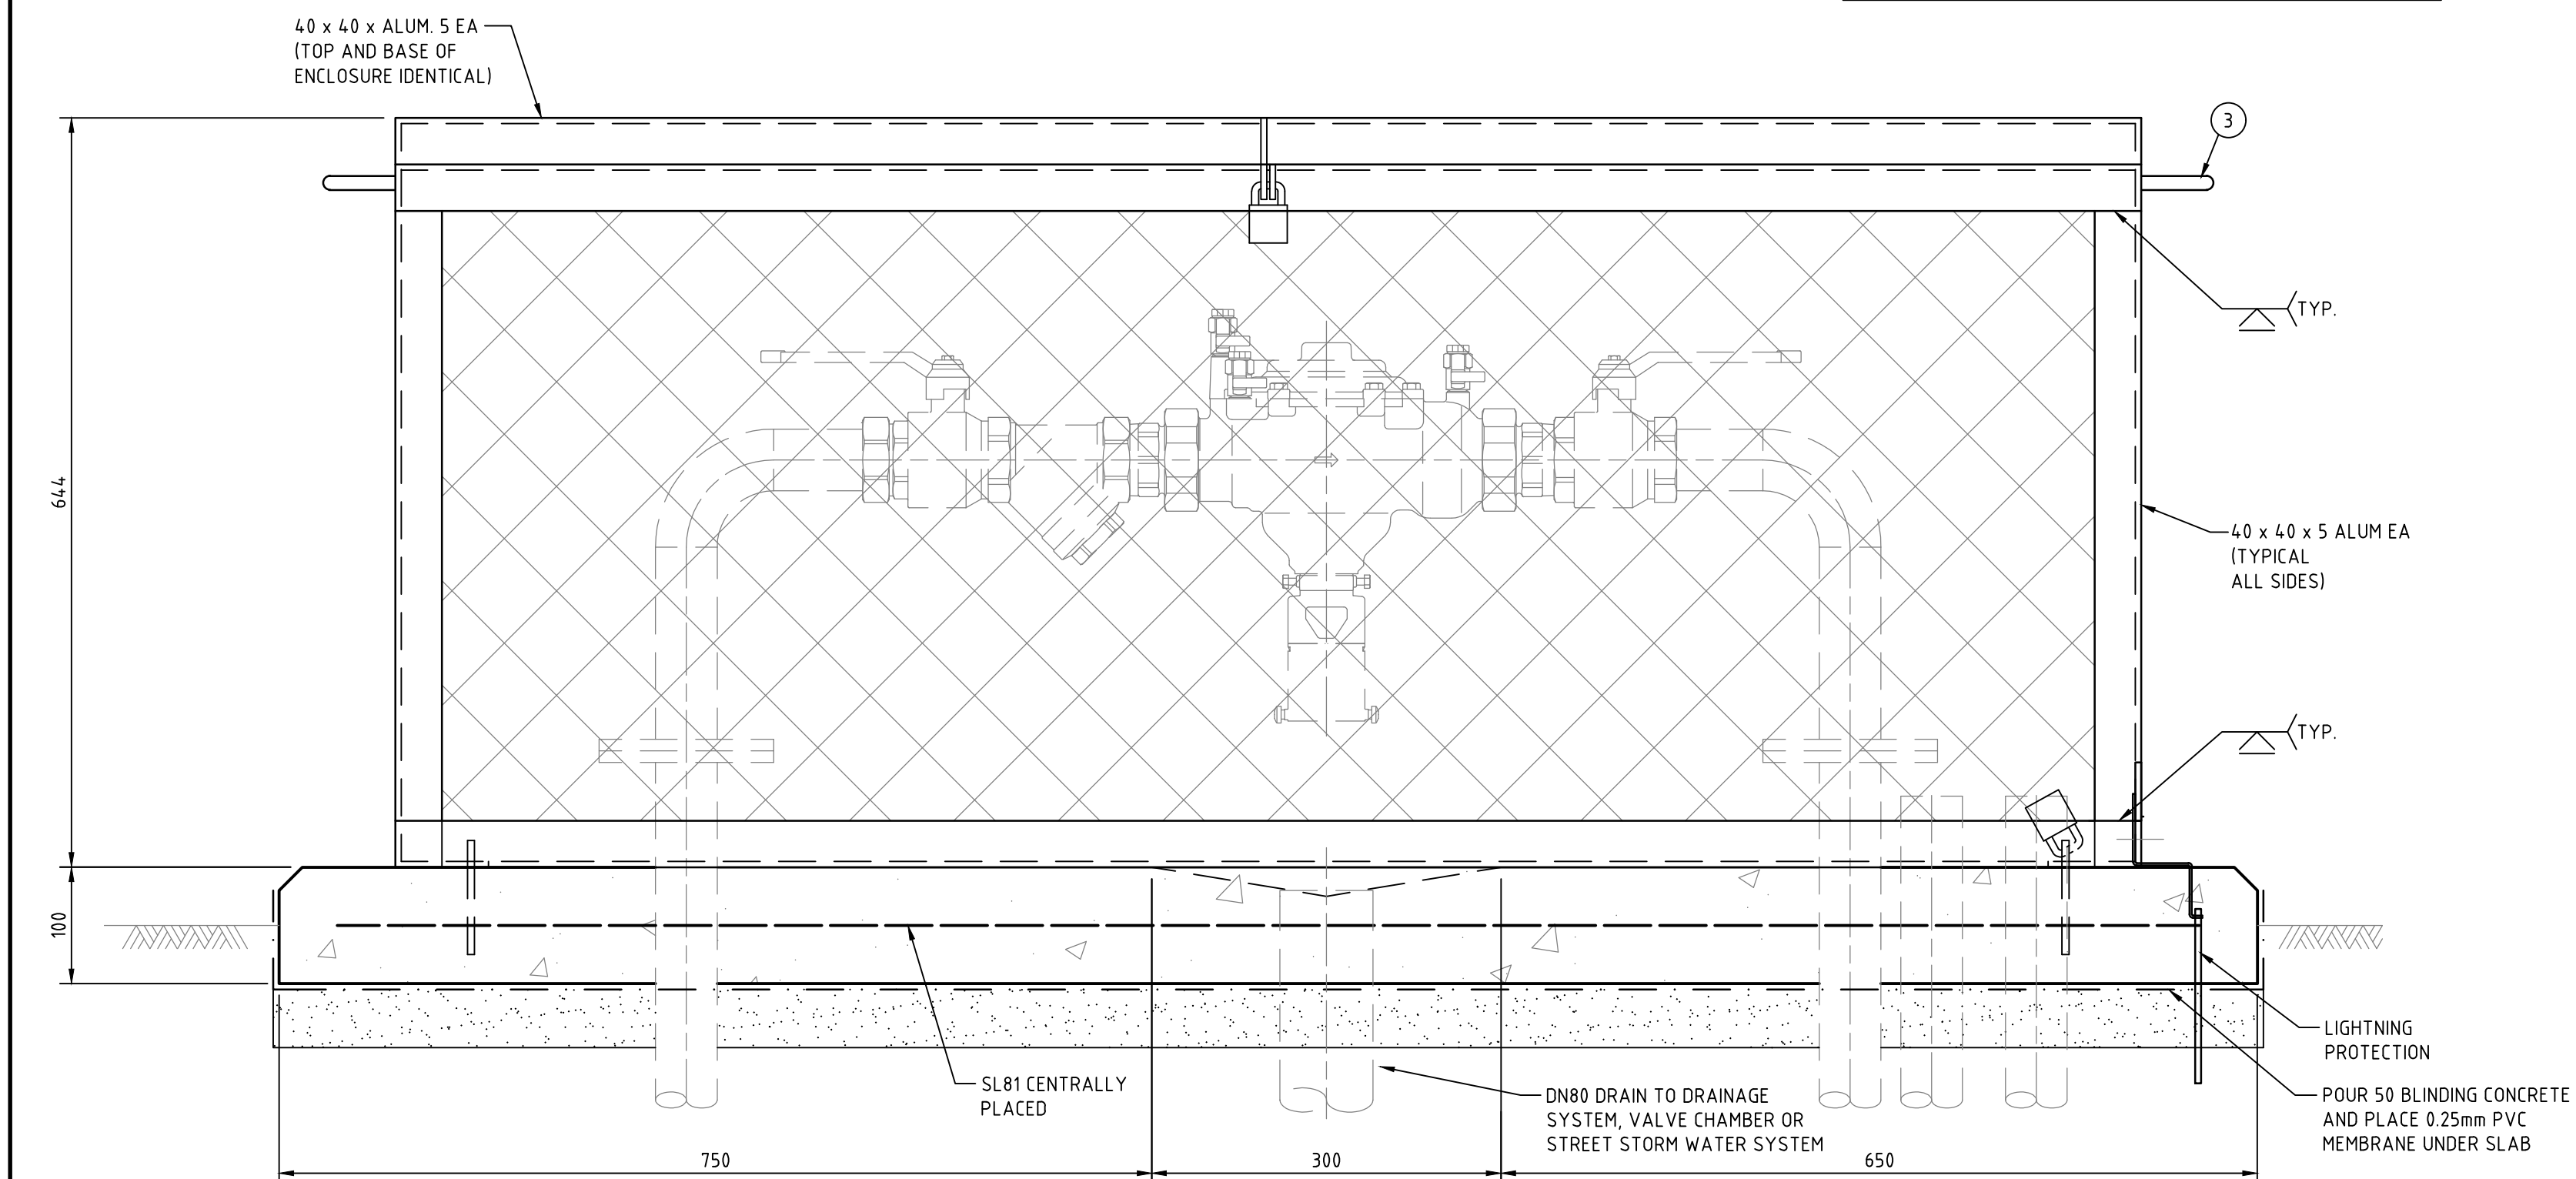

ELEVATION OF ENCLOSURE
SCALE 1:5



SIDE ELEVATION OF ENCLOSURE
SCALE 1:5