



THIS DRAWING MAY ONLY BE USED IN THE COURSE OF AND FOR THE PURPOSE OF CREATING SYDNEY WATER ASSETS. USE THIS DRAWING WITH CARE. YOU ARE RESPONSIBLE TO APPLY THE WORK SHOWN IN THIS DRAWING CORRECTLY IN THE CIRCUMSTANCES OF YOUR PROJECT. YOU MUST ENSURE THE WORK IS FIT FOR PURPOSE AND WILL PERFORM ITS INTENDED FUNCTION AS REQUIRED.

NOTES:


1. FOR GENERAL NOTES REFER TO DRG No. DTC-7002.
2. MOTORIZED VALVE TO BE DRIVEN BY BATTERY PACK DURING POWER FAILURE. BATTERIES SHALL NOT BE ATTACHED DIRECTLY TO VALVE.

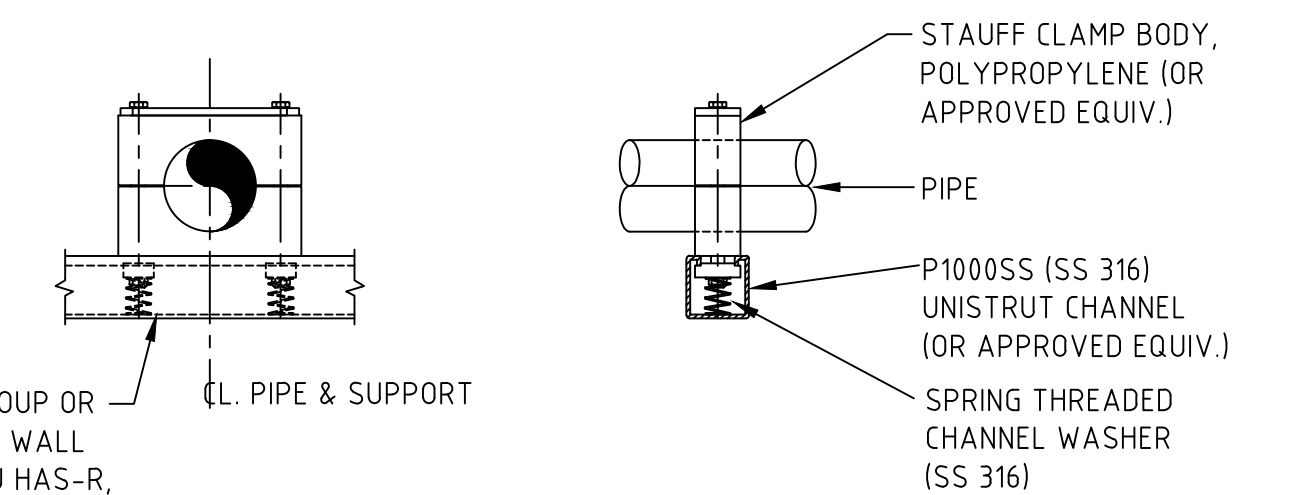


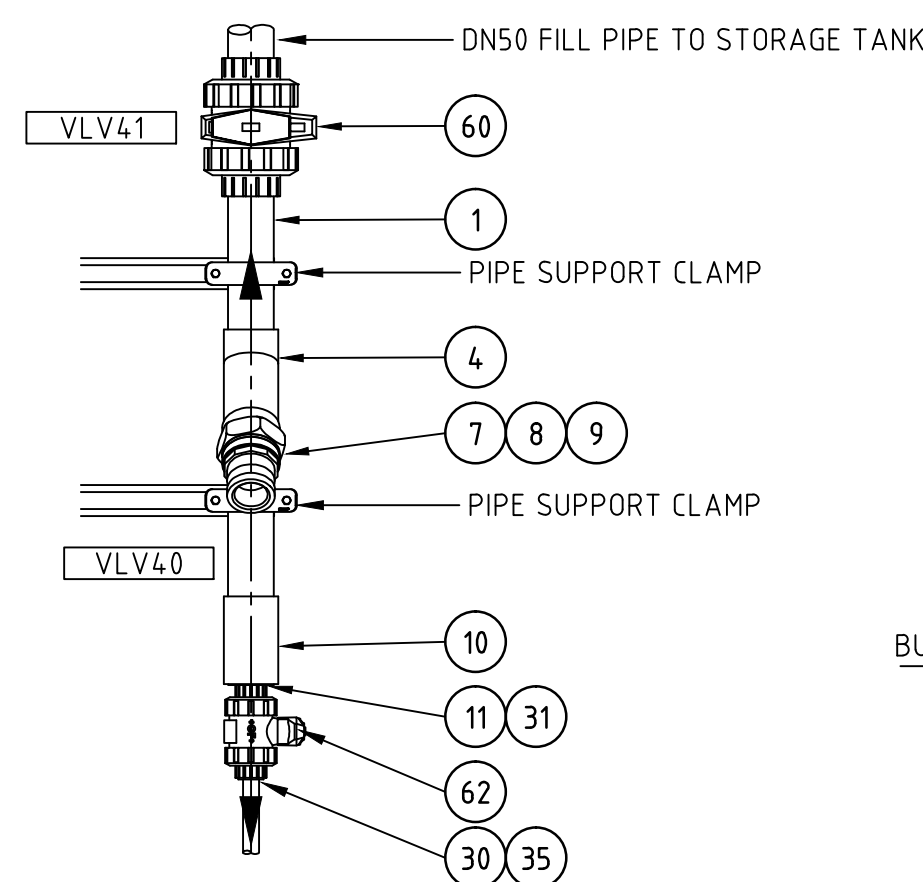
DETAIL  HEAVY DUTY PIPE CLAMP
SCALE 1:5 TO BE USED FOR PIPES DN50>

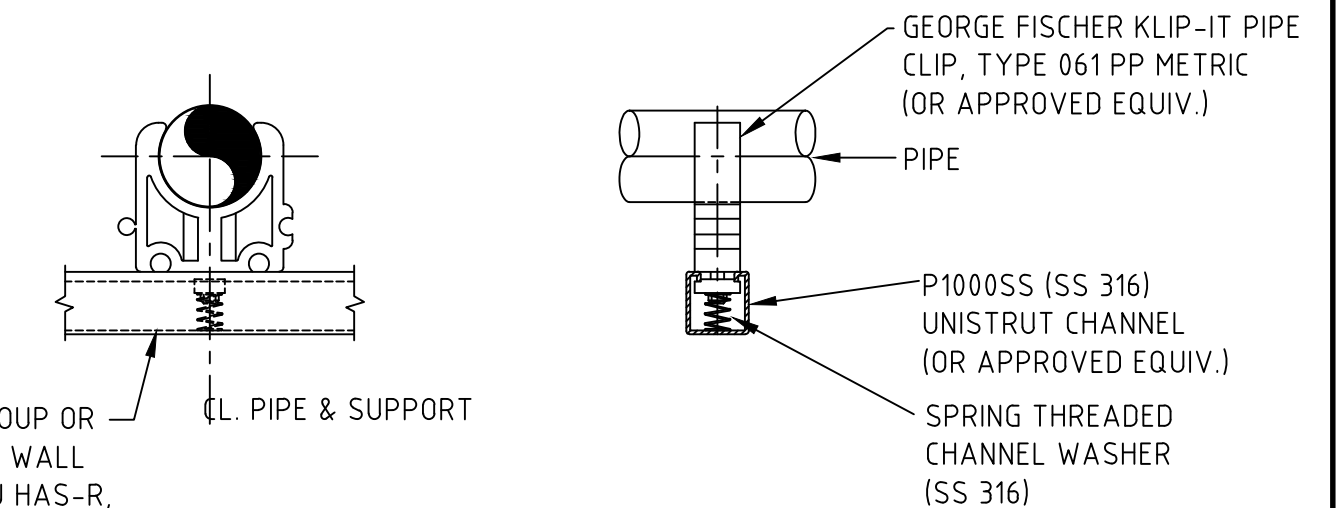

DETAIL  STANDARD PIPE CLAMP
SCALE 1:5 TO BE USED FOR PIPES <DN40

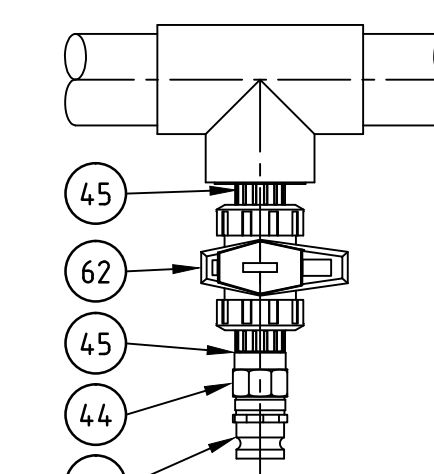


DETAIL SCALE 1:5  TYPICAL FLUSH POINT




DETAIL
SCALE 1:10

A
7131


FILL POINT DETAIL

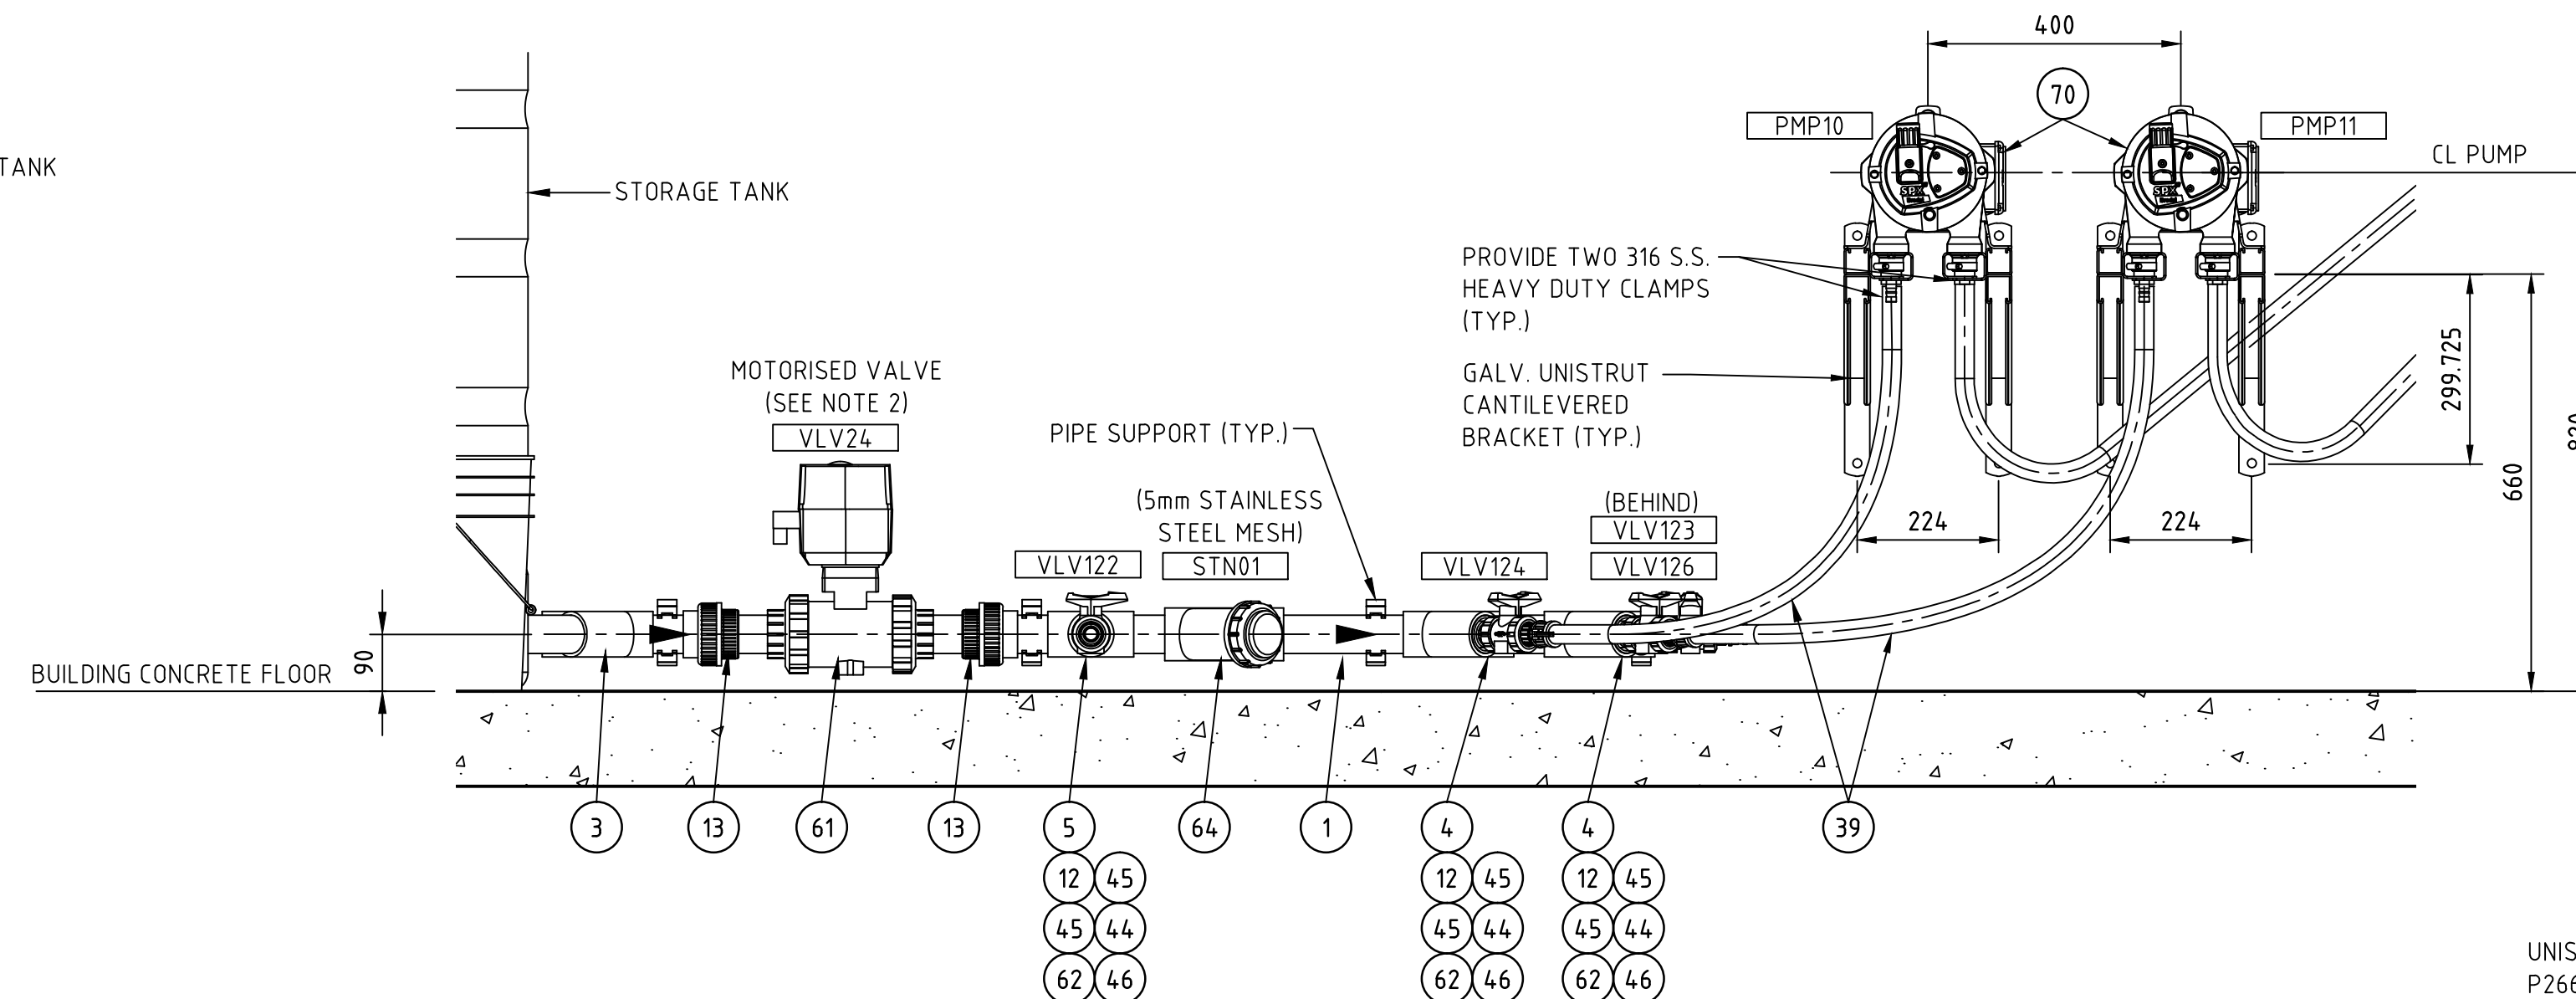

DETAIL B STORAGE TANK OUTLET &
SCALE 1:10 7132 STRAINERS & DOSING PUMPS

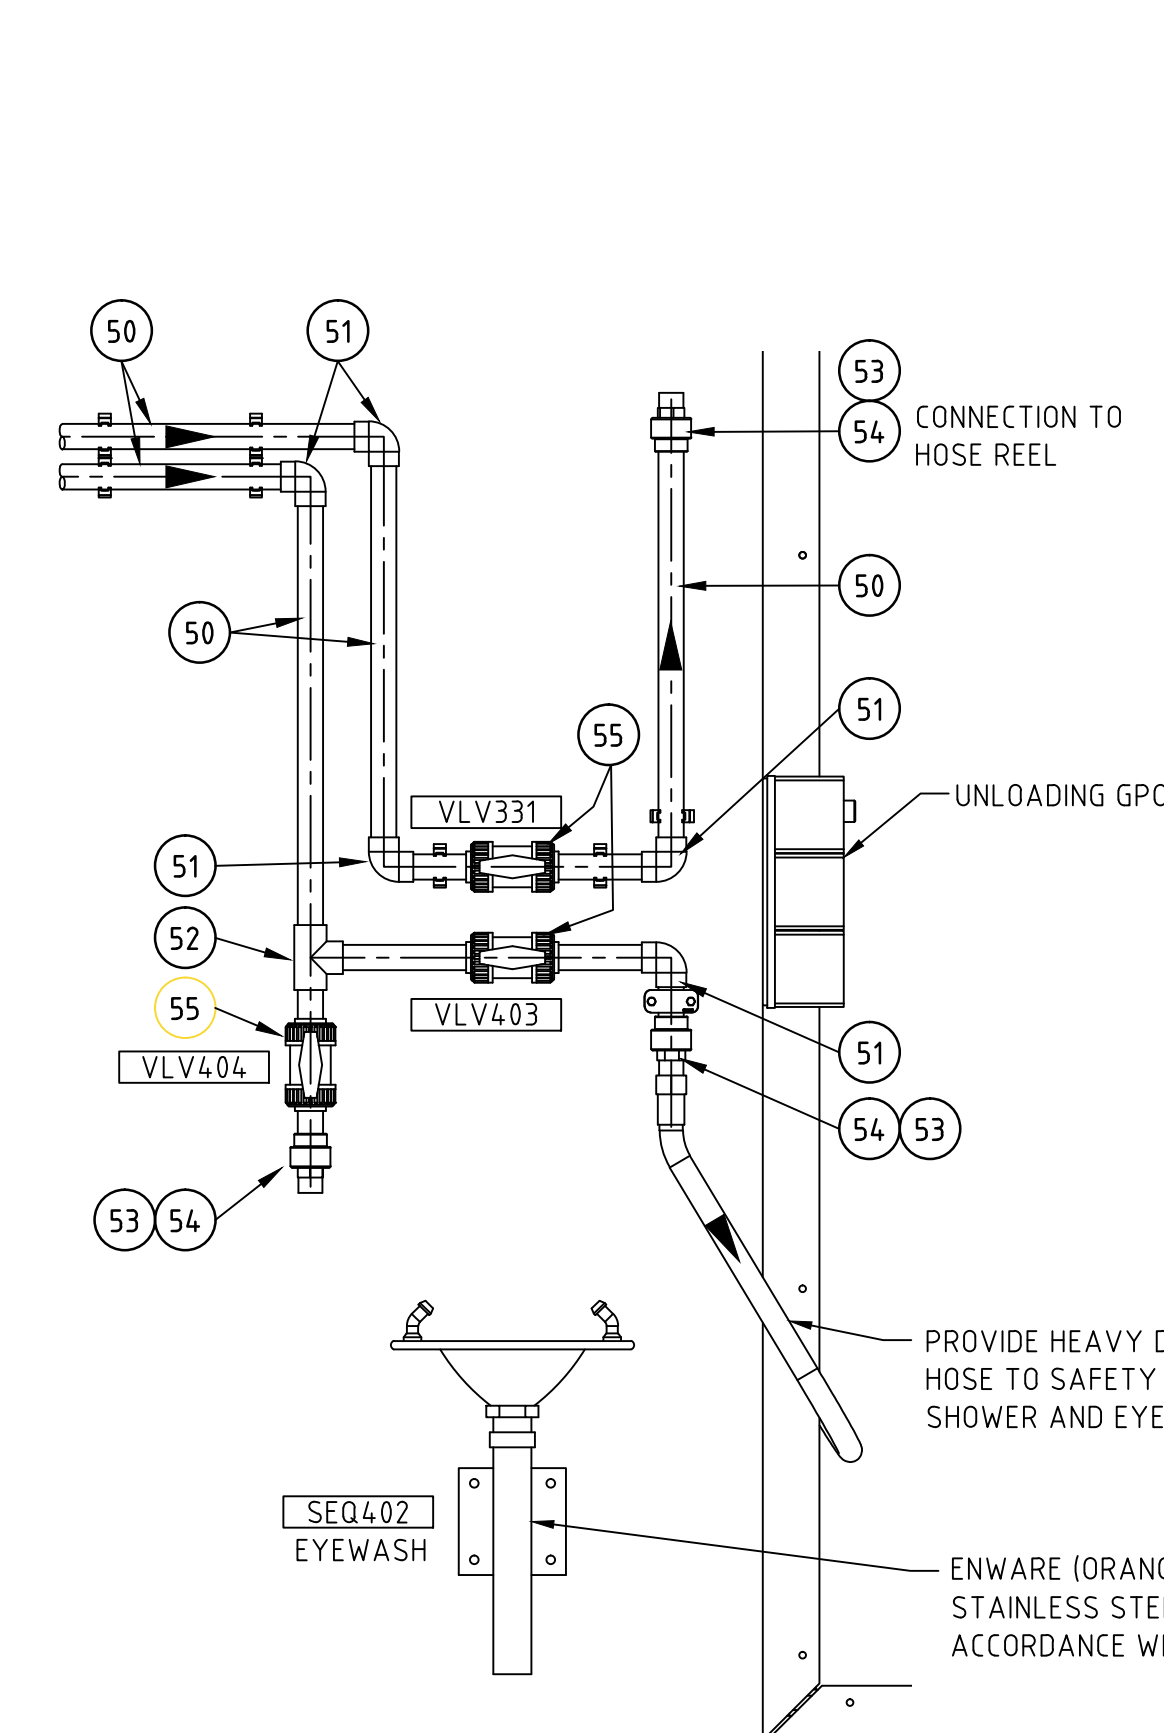

DETAIL  DILUTION WATER VALVES TO
SCALE 1:10 7132 SAFETY SHOWER AND EYE WASH

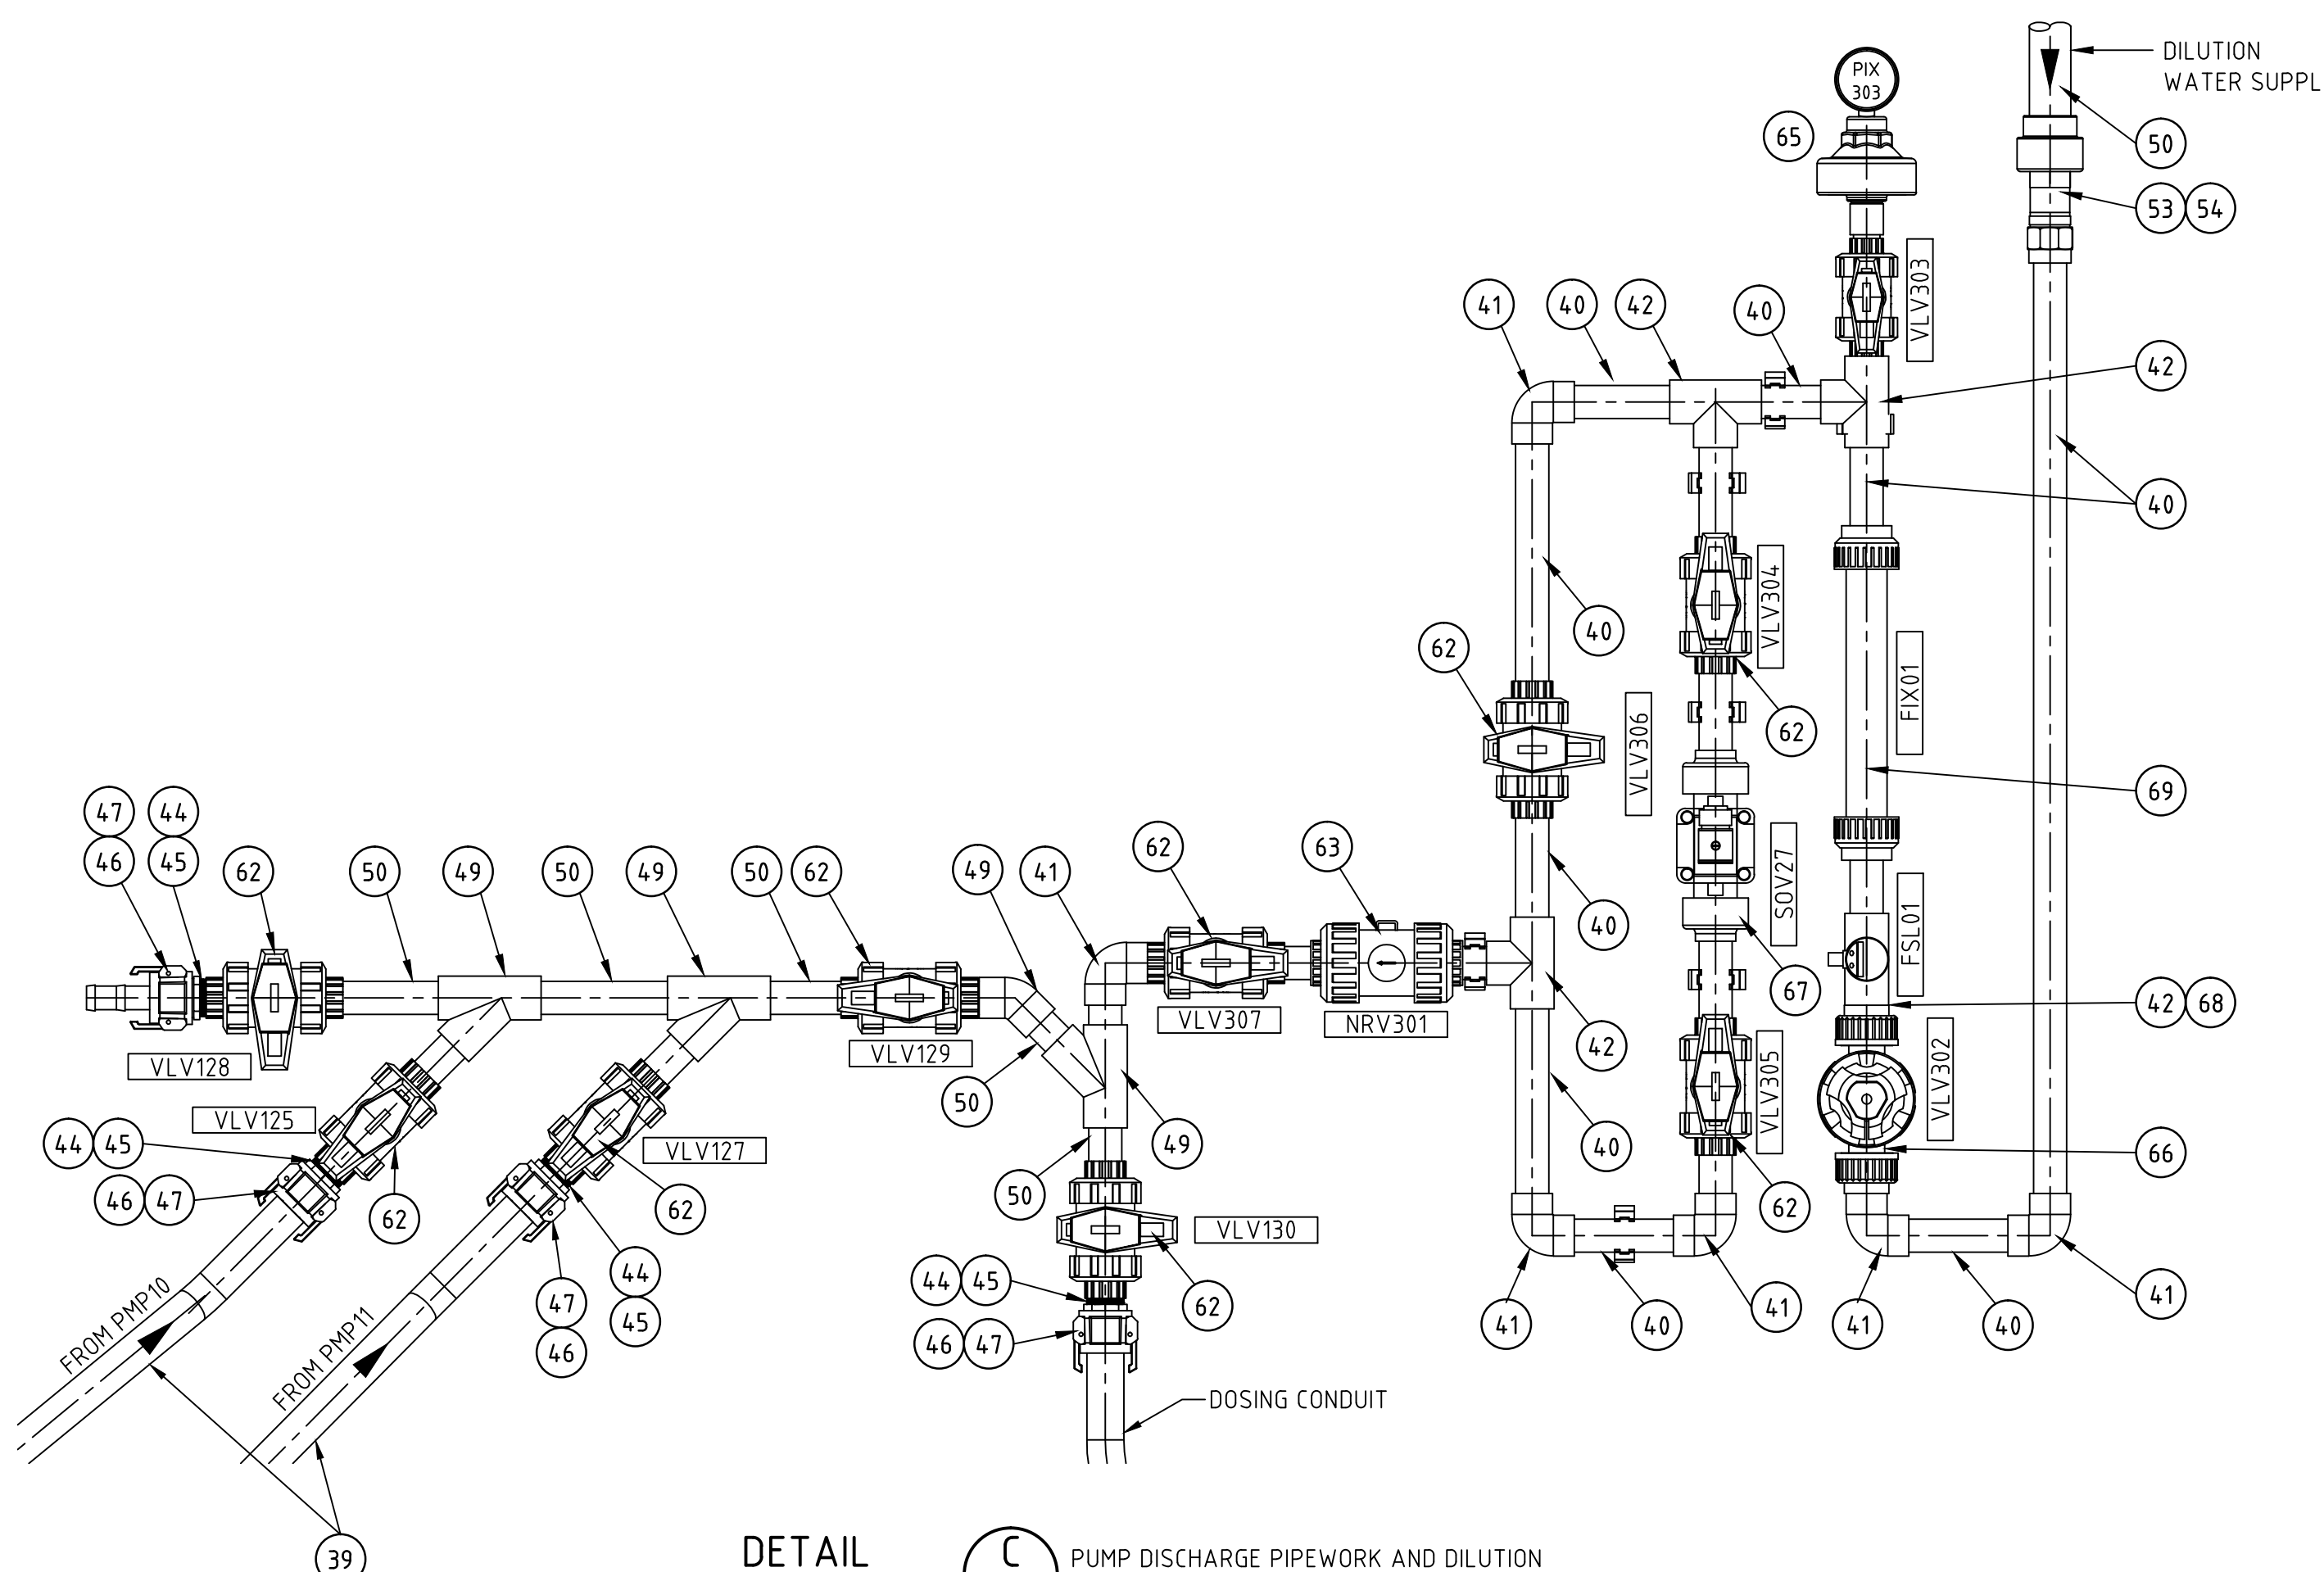

DETAIL SCALE 1:5

 PUMP DISCHARGE PIPEWORK AND DILUTION
WATER VALVES & CONTROLS

Sydney **WATER**

© COPYRIGHT

STATE OF NEW SOUTH WALES THROUGH SYDNEY
WATER CORPORATION. ALL RIGHTS RESERVED

APPROVED

MAR 2017

KEN WIGGINS

MANAGER, E & ES

ENGINEERING & ENVIRONMENTAL SERVICES

A

ORIGINAL ISSUE

DETAILS OF AMENDMENT

KW

10/03/17

	APP'D
--	-------

DATE _____

DEEMED TO COMPLY DRAWINGS

**5kL CHEMICAL DOSING UNIT
MAGNESIUM HYDROXIDE
PIPEWORK DETAILS - SHEET 2 OF 2**

DTC

7134