




A1

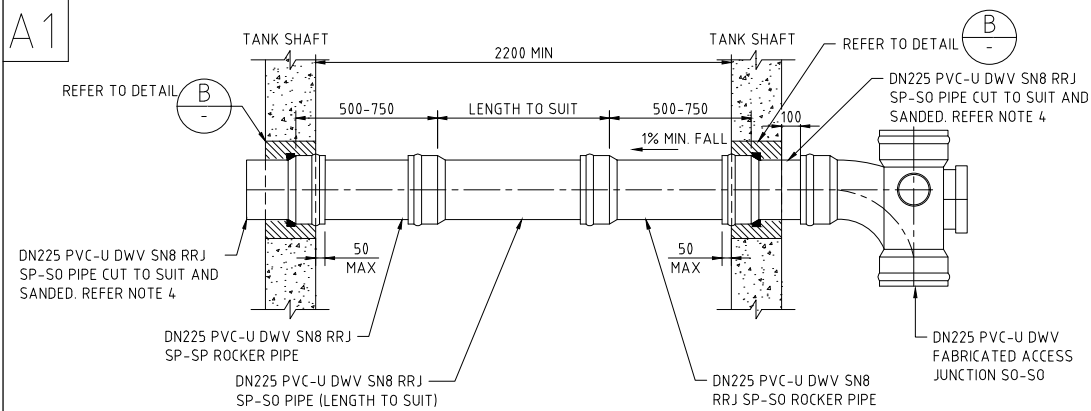


COMPONENT No. A302a  
INTERCONNECTING PIPE ASSEMBLY  
(A302b IS SIMILAR WITHOUT THE JUNCTION)  
SCALE 1:20

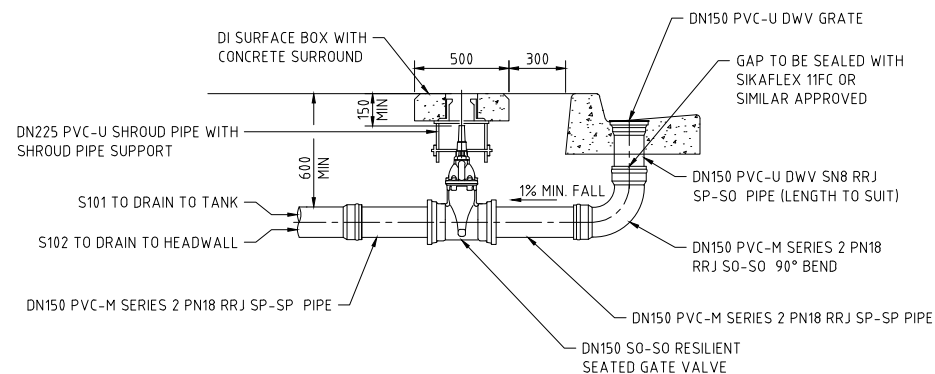


COMPONENT No. S101 & S102  
HARDSTAND DRAINAGE PIPEWORK ASSEMBLY  
SCALE 1:20

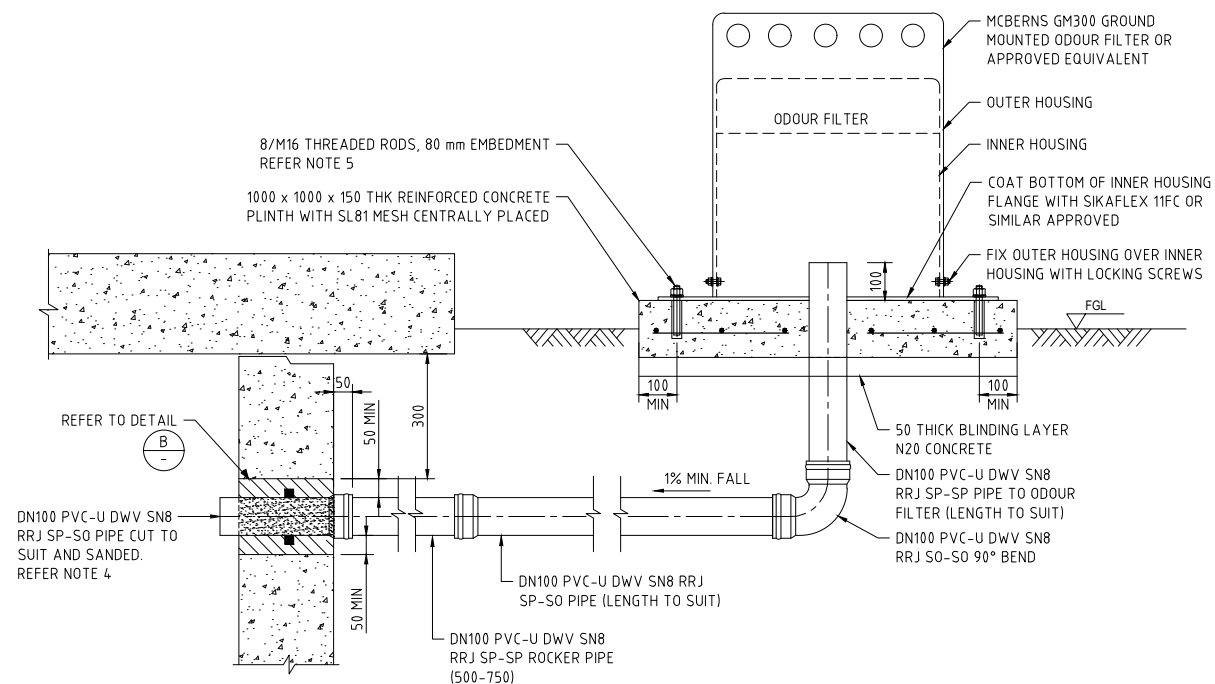


COMPONENT No. A303  
ODOUR CONTROL UNIT & PIPEWORK ASSEMBLY  
SCALE 1:10

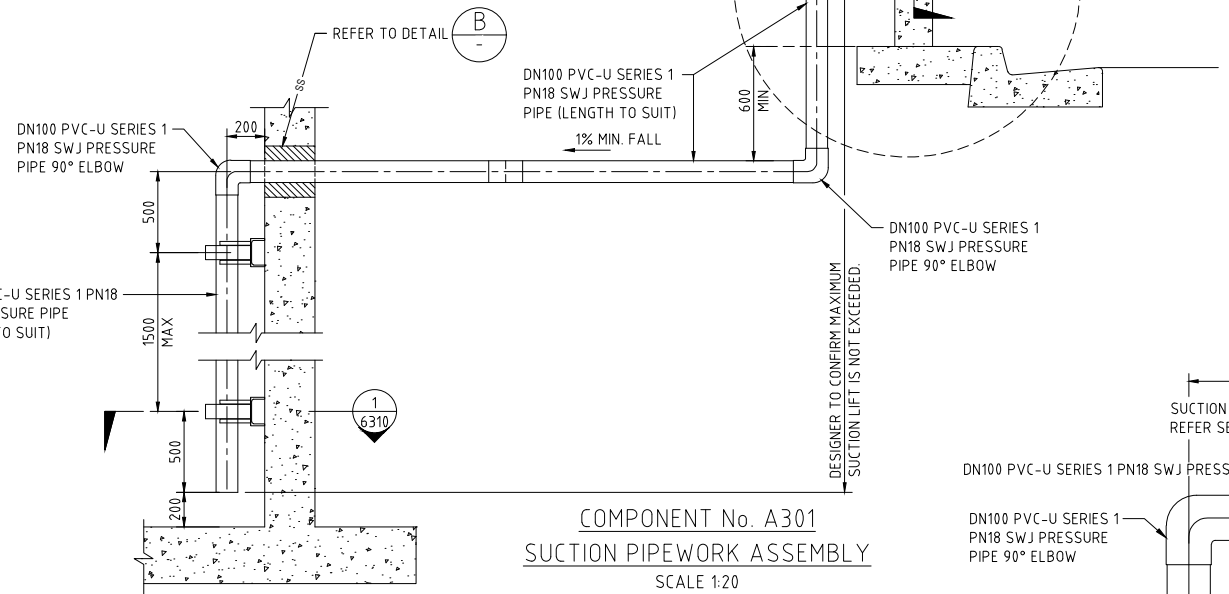

COMPONENT No. A301  
SUCTION PIPEWORK ASSEMBLY  
SCALE 1:20

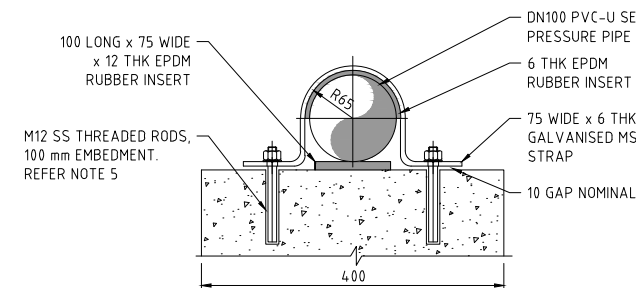

SECTION 7  
SCALE 1:5  
SUCTION PIPE SADDLE

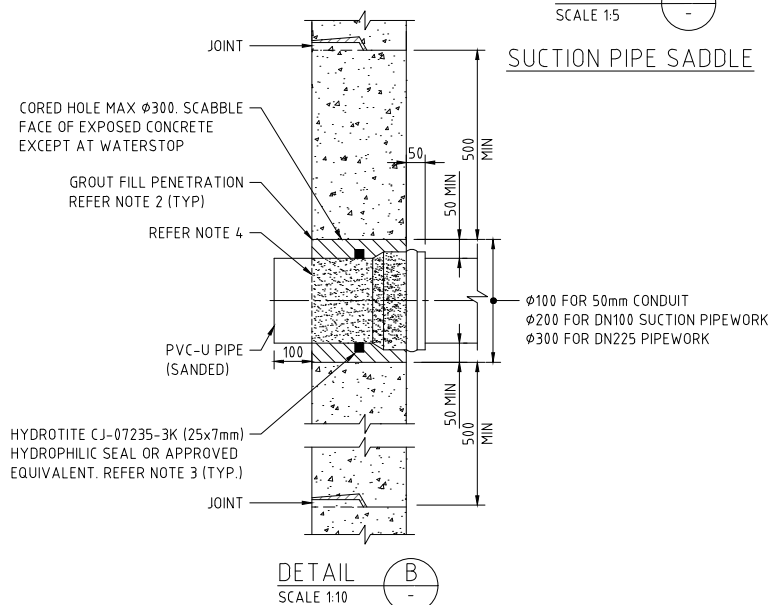


DETAIL B  
SCALE 1:10  
TYPICAL PVC-U PIPE PENETRATION DETAIL


THIS DRAWING MAY ONLY BE USED IN THE COURSE OF AND FOR THE PURPOSE OF CREATING SYDNEY WATER ASSETS. USE THIS DRAWING WITH CARE. THE USER IS RESPONSIBLE FOR THE CORRECT APPLICATION OF THIS DRAWING. DEEMED TO COMPLY DRAWINGS ARE SUBJECT TO TERMS AND CONDITIONS OF USE AS PUBLISHED BY SYDNEY WATER.

#### NOTES:

1. THIS DRAWING MUST BE READ IN CONJUNCTION WITH THE DEEMED TO COMPLY DRAWINGS AS LISTED ON DTC/6301.
2. GROUT FILL AFTER PIPE INSTALLATION WITH SIKADUR 31 OR APPROVED EQUIVALENT.
3. MAINTAIN MIN.75mm COVER TO WATERSTOP. WATERSTOP TO BE SECURED AND INSTALLED TO MANUFACTURER'S INSTRUCTIONS.
4. A SINGLE LAYER OF SAND IS TO BE SOLVENT BONDED AROUND PIPE, OVER FULL LENGTH OF PENETRATION AFTER CLEANING PIPE WITH PRIMING FLUID.
5. USE CHEMICAL ANCHOR HILTI HIT-RE 100 OR APPROVED EQUIVALENT. DRILL HOLE DIAMETERS TO MANUFACTURER SPECIFICATIONS.
6. BOX OUT MUST BE PROVIDED TO ALL PIPE PENETRATIONS U.N.O. HYDROTITE CJ-07235-3K (25x7mm) HYDROPHILIC SEAL MUST BE INSTALLED.

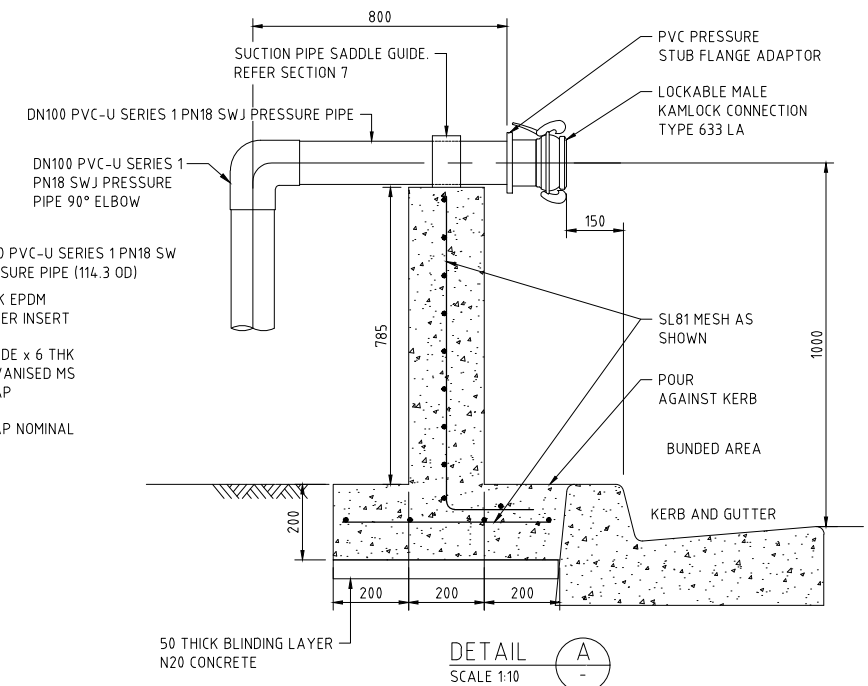

DETAIL A  
SCALE 1:10

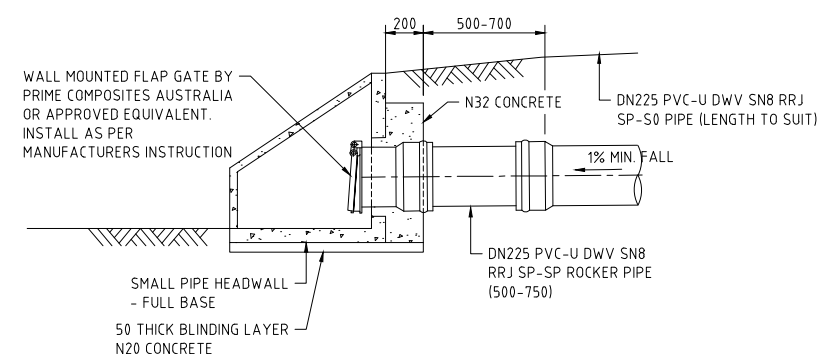

COMPONENT No. S300  
OVERFLOW DISCHARGE POINT  
SCALE 1:20

**Sydney**  
**WATER**

© COPYRIGHT  
STATE OF NEW SOUTH WALES THROUGH SYDNEY  
WATER CORPORATION. ALL RIGHTS RESERVED

APPROVED

NORBERT SCHAEFER  
ENGINEERING MODERNISATION MANAGER

ENGINEERING & TECHNICAL SUPPORT

B  
A  
LETTER

GENERAL UPDATE  
ORIGINAL ISSUE  
DETAILS OF ISSUE / AMENDMENT

NS  
KW  
APP'D  
DATE

31/07/24  
22/06/15

DEEMED TO COMPLY DRAWINGS  
TEMPORARY SEWAGE PUMP-OUT INSTALLATION  
ASSEMBLY DETAILS  
SHEET 3 OF 3

**DTC**  
**6312**

ISSUE  
DATE  
B 31/07/24