

Upper South Creek

Advanced Water Recycling Centre and Pipelines PART E

CoA E92 Construction Water Reuse Strategy

Document No: USCP-JHG-PLN-ENV-0001
Revision No: A


Stage 3: Brine Tanks

Source - MBR and Digesters (11.62ML)

Brine tanks

i) Brine #1 = 10.21 ML

-> ii) Brine #2 = 10.21 ML

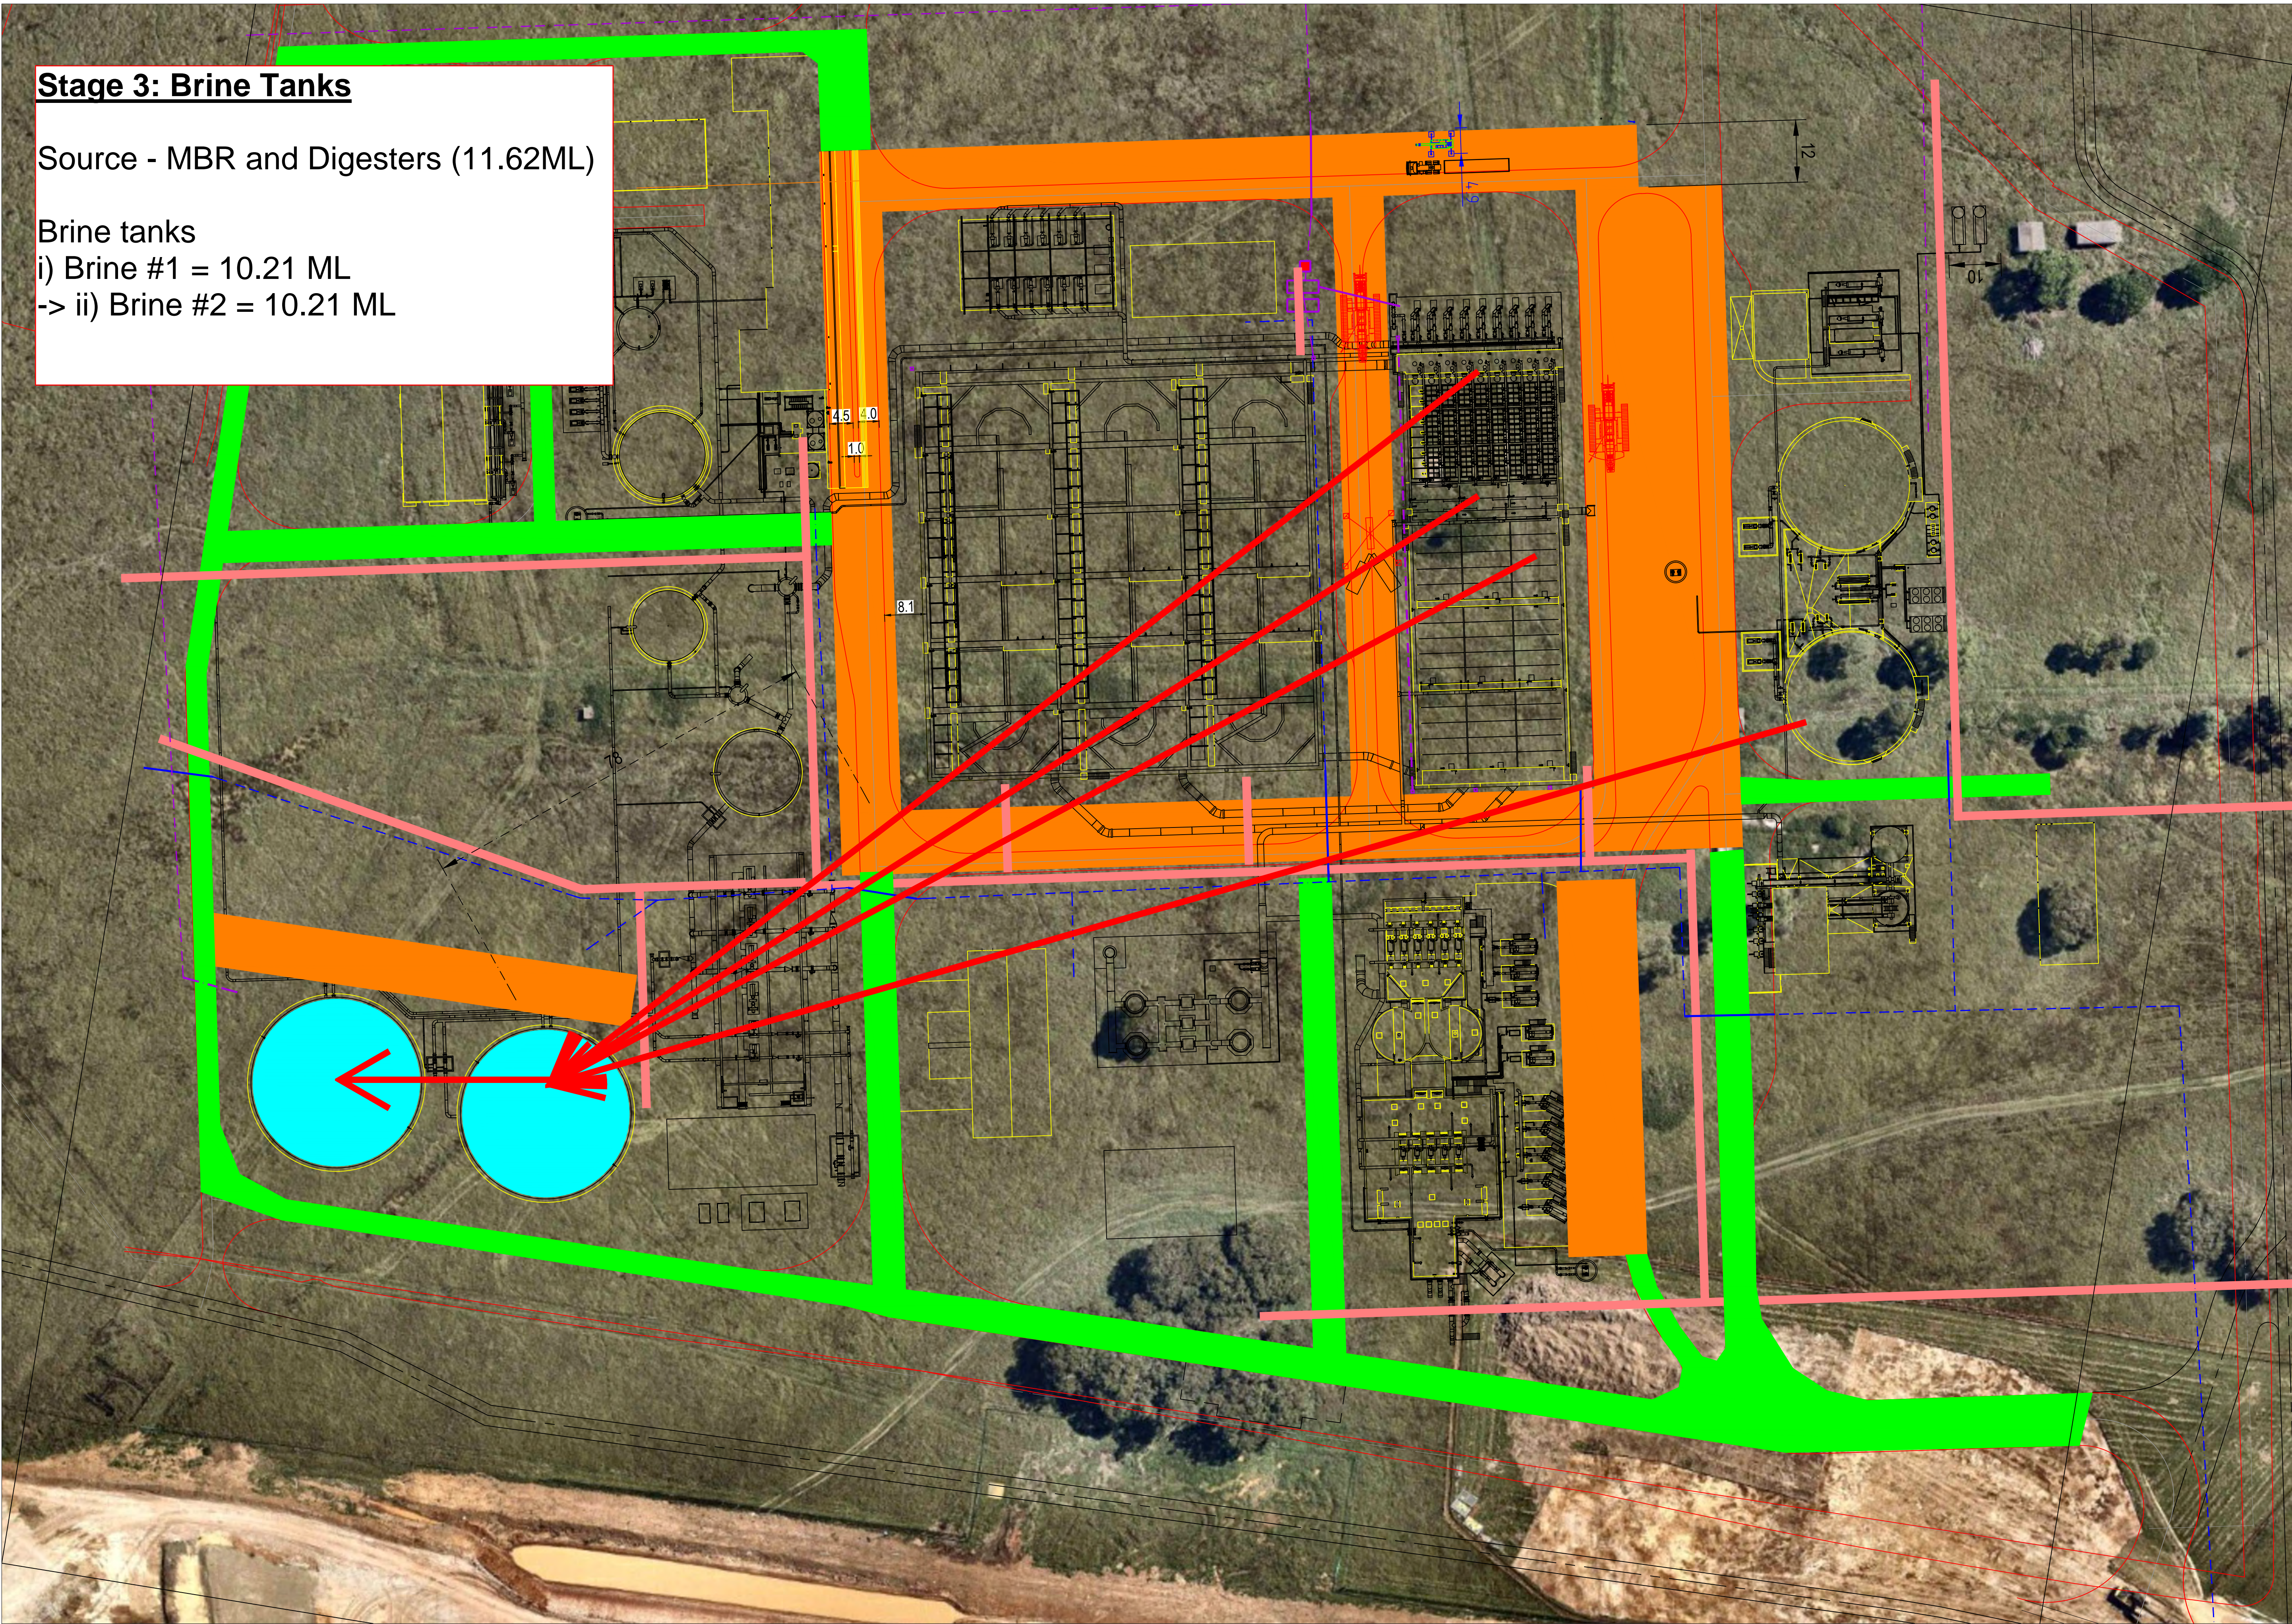

Stage 4: Inlet Works

Source - Brine Tanks (10.62 ML)

Inlet Works

i) Stage #1 (Coarse Screen) = 1.763 ML

-> ii) Stage #2 (Grit Chambers) = 0.791 ML

-> iii) Stage #3 (Fine Screens) = 0.633 ML

